HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

Report No.: 001 Test Time: 2019-10-14 16:23

Luminaire Property


Luminaire Manufacturer:
Luminaire Category: Track Lighting
Luminaire Description: HCP-10X1000-3W-3000K
Lamp Catalog: COB
Luminous Length (mm): -38
Luminous Width (mm): -38
Luminous Height (mm): 0
Voltage: 230.6 V
Current: 0.031 A
Power: 3.26 W
Power Factor: 0.460

Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 283.0 lm
Measurement Flux: 283 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 140.8, 141.1, 141.2, 141.0
Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 81.3, 81.6, 81.5, 81.6
Luminaire Efficacy Rating (LER): 86.86
Central Intensity: 146.43 cd
Max. Intensity: 147.31 cd
Pos of Max. Intensity: H315 V1
S/MH(C0/C180): 1.10
S/MH(C90/C270): 1.10

Picture Of Luminaire

Luminous Intensity Distribution Curve

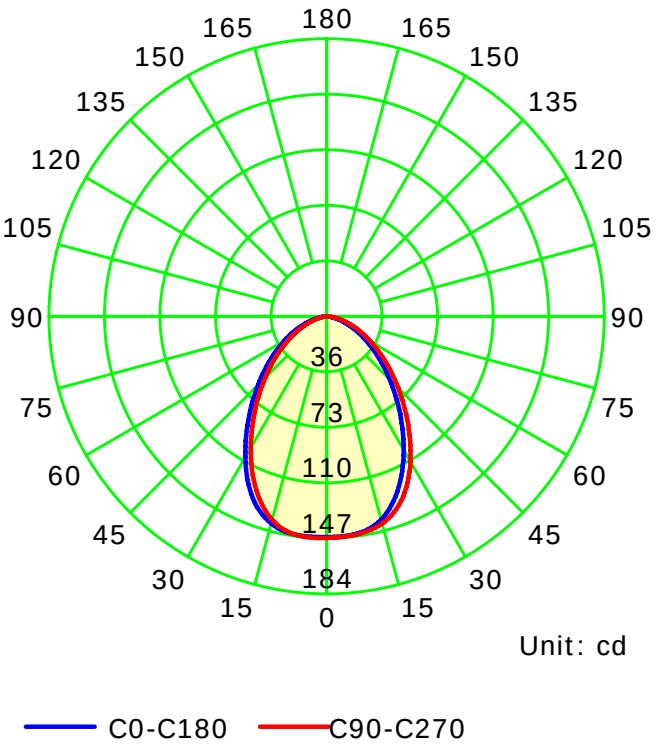



Unit: cd

C Plane (°):0.0-360.0: 45.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab: Havit Commercial
Test Device: GPM-1600L
Test Type: TYPE C
Distance: 6.583 m
Temperature: 25°C
Humidity:
Operator: DING LI
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel: 02 9381 8383
E-mail:sales@havitcommercial.com.au

Luminous Intensity Distribution Curve

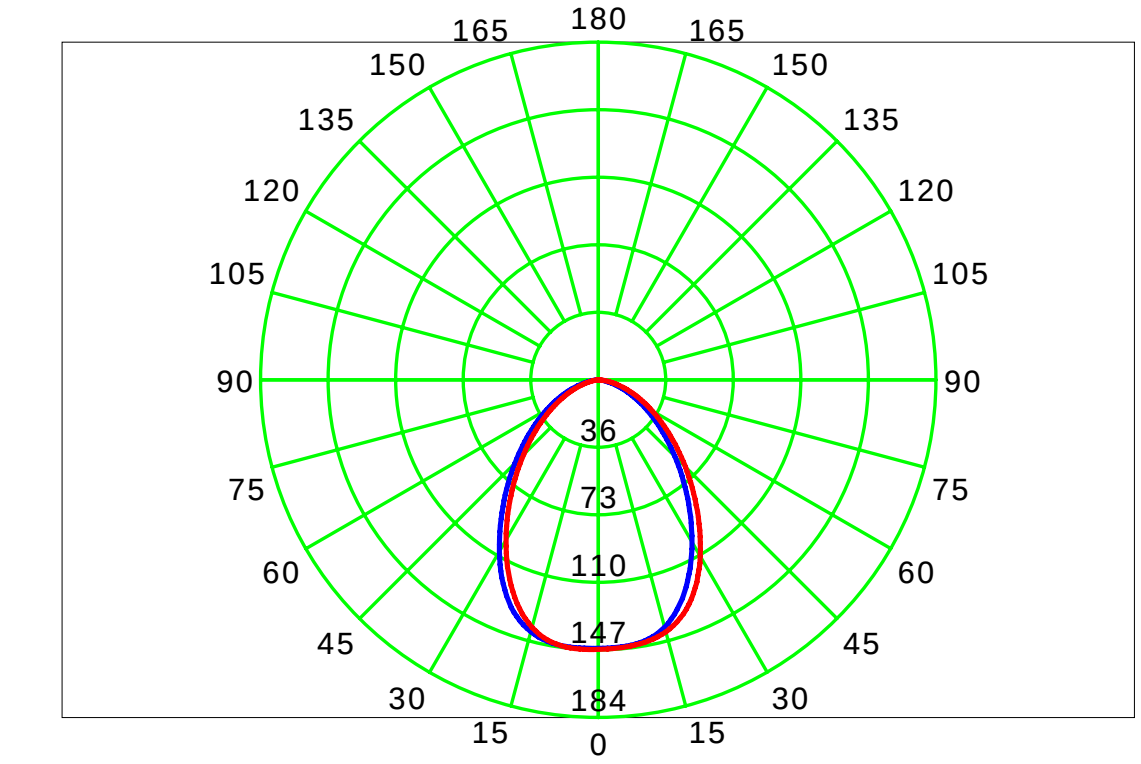

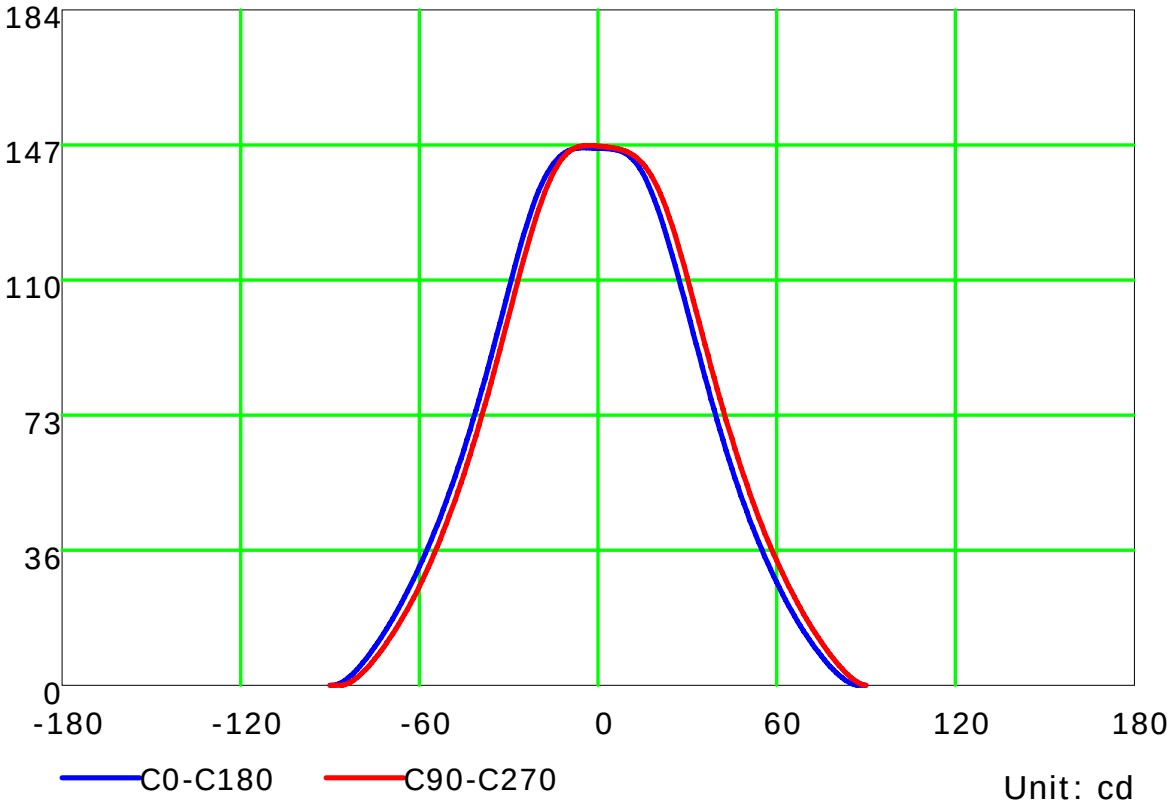


C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

IsoLux Plot

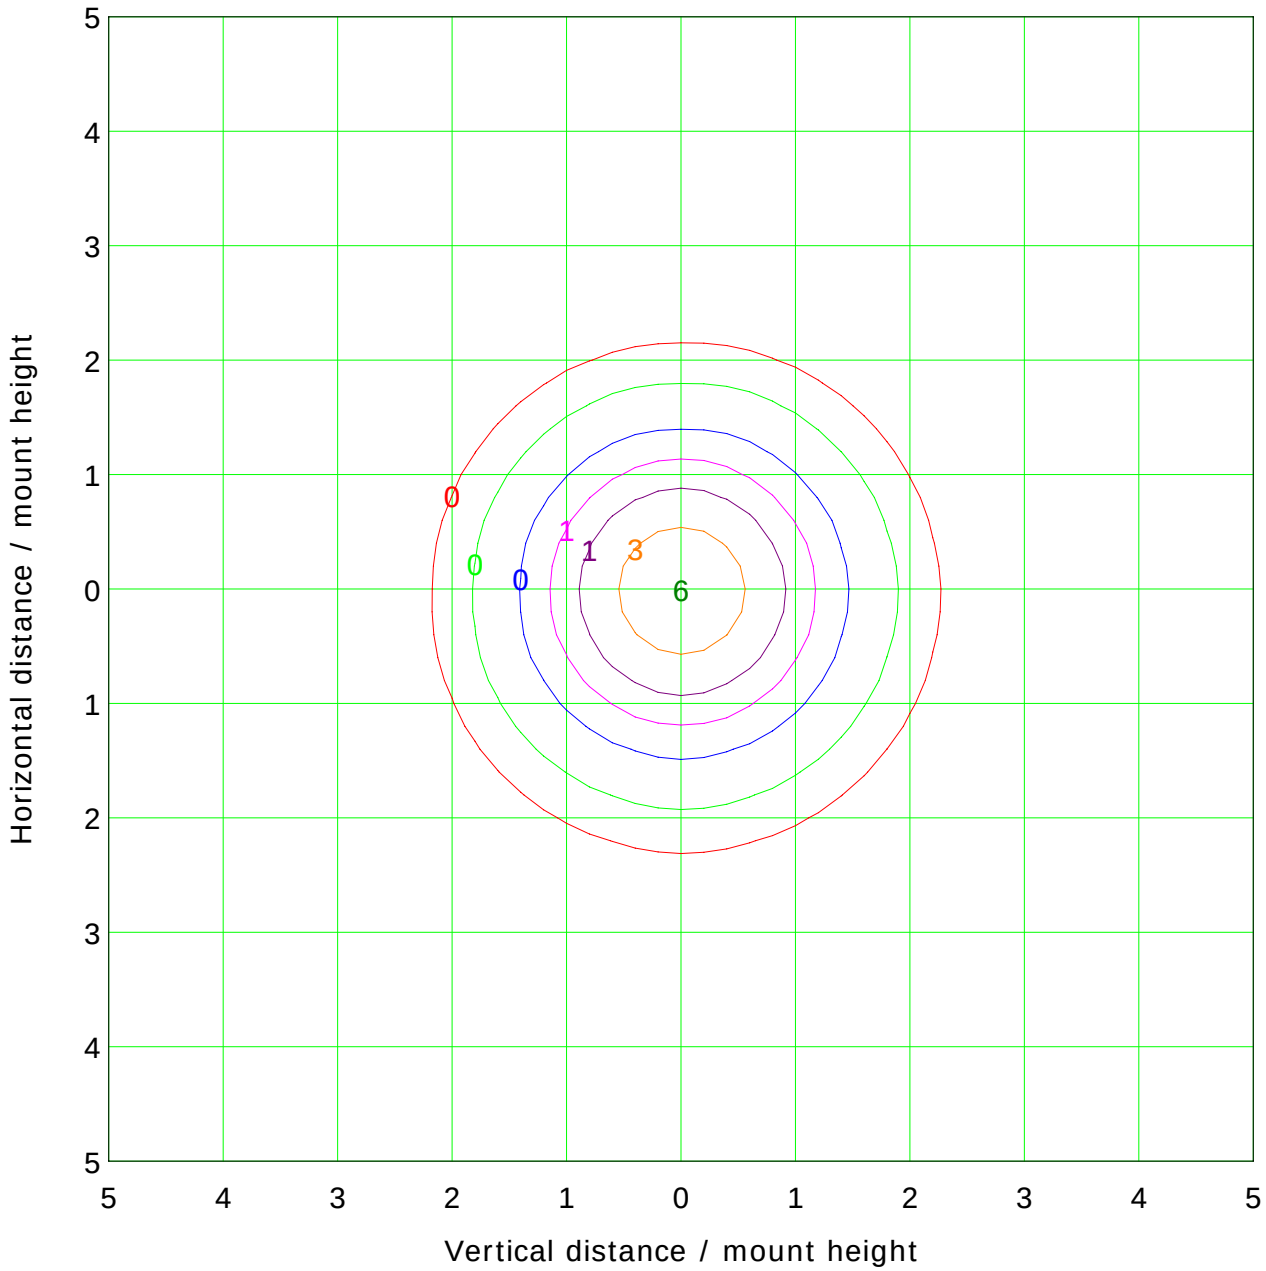

Mounting Height: 5.0m Max Lux(100%): 5.9 lx


(1%): 0.1 lx	(2%): 0.1 lx
(5%): 0.3 lx	(10%): 0.6 lx
(20%): 1.2 lx	(50%): 2.9 lx
(100%): 5.9 lx	

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

Illuminance at a Distance

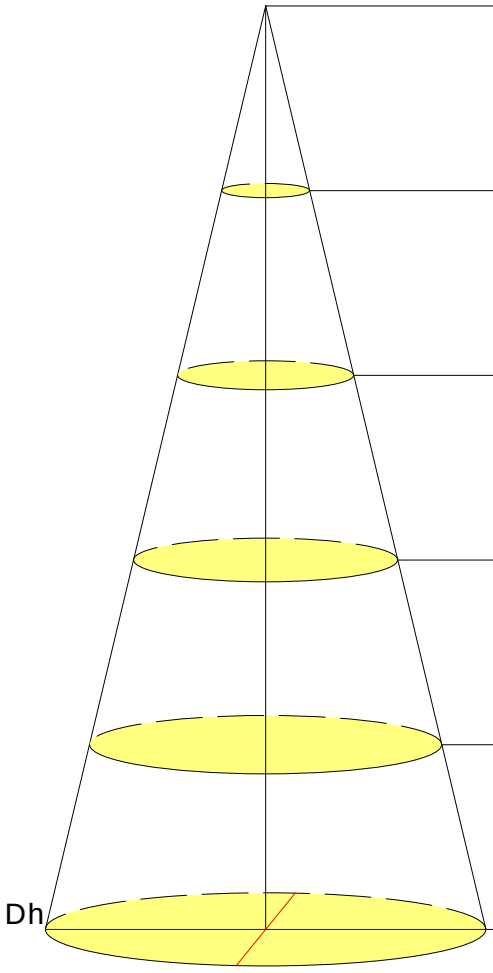

Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
1.0	146.43	1.72/1.73	2.3	41.27
2.0	36.61	3.44/3.45	9.4	10.32
3.0	16.27	5.15/5.18	21.1	4.59
4.0	9.15	6.87/6.91	37.5	2.58
5.0	5.86	8.59/8.64	58.6	1.65

Beam Angle(B): H81.3 V81.6 Field Angle(F): H140.8 V141.1

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	25.9	27.2	26.2	27.4	27.6	26.2	27.5	26.5	27.7	27.9
3H	26.8	27.9	27.1	28.1	28.4	27.2	28.3	27.5	28.5	28.8
4H	27.0	28.1	27.4	28.3	28.6	27.5	28.5	27.8	28.8	29.1
6H	27.1	28.1	27.5	28.4	28.7	27.6	28.6	28.0	28.9	29.2
8H	27.1	28.0	27.5	28.4	28.7	27.7	28.6	28.0	28.9	29.2
12H	27.1	28.0	27.5	28.3	28.6	27.7	28.6	28.0	28.9	29.2
X=4H Y=2H	26.4	27.4	26.7	27.7	28.0	26.6	27.7	27.0	28.0	28.3
3H	27.4	28.3	27.8	28.6	28.9	27.7	28.6	28.1	29.0	29.3
4H	27.7	28.5	28.1	28.9	29.2	28.1	28.9	28.5	29.3	29.7
6H	27.9	28.6	28.3	29.0	29.4	28.4	29.1	28.8	29.5	29.9
8H	27.9	28.6	28.3	28.9	29.4	28.4	29.1	28.9	29.5	29.9
12H	27.9	28.5	28.3	28.9	29.3	28.5	29.0	28.9	29.4	29.9
X=8H Y=4H	27.9	28.5	28.3	28.9	29.3	28.3	28.9	28.7	29.3	29.7
6H	28.1	28.6	28.6	29.1	29.5	28.6	29.1	29.0	29.5	30.0
8H	28.1	28.6	28.6	29.0	29.5	28.7	29.1	29.1	29.6	30.0
12H	28.1	28.5	28.6	29.0	29.5	28.7	29.1	29.2	29.6	30.1
X=12H Y=4H	27.9	28.4	28.3	28.9	29.3	28.2	28.8	28.7	29.2	29.7
6H	28.1	28.6	28.6	29.0	29.5	28.6	29.0	29.1	29.5	30.0
8H	28.2	28.6	28.7	29.0	29.5	28.7	29.1	29.2	29.5	30.0
Variations with the observer position at spacings:										
S=1.0H	+0.3/-0.4					+0.3/-0.5				
S=1.5H	+0.5/-1.0					+0.6/-1.1				
S=2.0H	+1.1/-1.8					+0.9/-1.9				

Calculate in accordance with CIE Pub.117. The table is revised with 283lm (8log(F/F0) = -4.4).

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

Candlepower Table

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G0.0	146.4	146.8	147.0	147.3	146.4	146.8	147.0	147.3	146.4	
G1.0	146.4	146.7	147.0	147.3	146.5	146.9	147.1	147.3	146.4	
G2.0	146.4	146.6	146.9	147.2	146.5	146.9	147.1	147.3	146.4	
G3.0	146.3	146.5	146.8	147.2	146.6	146.9	147.2	147.3	146.3	
G4.0	146.3	146.4	146.7	147.2	146.6	147.0	147.2	147.3	146.3	
G5.0	146.2	146.3	146.6	147.1	146.6	147.0	147.1	147.2	146.2	
G6.0	146.0	146.1	146.4	147.0	146.6	146.9	147.0	147.1	146.0	
G7.0	145.8	146.0	146.2	146.9	146.5	146.8	146.8	146.9	145.8	
G8.0	145.5	145.7	146.0	146.7	146.3	146.6	146.4	146.7	145.5	
G9.0	145.1	145.5	145.7	146.4	146.1	146.2	146.0	146.2	145.1	
G10.0	144.7	145.1	145.4	146.1	145.8	145.8	145.4	145.7	144.7	
G11.0	144.0	144.5	145.0	145.7	145.3	145.1	144.6	144.9	144.0	
G12.0	143.1	143.9	144.5	145.2	144.8	144.4	143.7	144.1	143.1	
G13.0	142.3	143.3	143.9	144.6	144.1	143.6	142.6	143.1	142.3	
G14.0	141.0	142.3	143.1	143.9	143.2	142.4	141.2	141.8	141.0	
G15.0	139.7	141.3	142.3	143.0	142.3	141.2	139.8	140.5	139.7	
G16.0	138.2	140.1	141.3	142.0	141.0	139.8	138.0	138.9	138.2	
G17.0	136.3	138.7	140.1	140.8	139.8	138.1	136.2	137.0	136.3	
G18.0	134.5	137.3	138.9	139.6	138.3	136.4	134.3	135.1	134.5	
G19.0	132.3	135.4	137.3	137.9	136.5	134.2	131.9	132.9	132.3	
G20.0	130.1	133.6	135.8	136.3	134.8	132.2	129.7	130.6	130.1	
G21.0	127.9	131.4	134.0	134.4	132.8	130.0	127.2	128.3	127.9	
G22.0	125.3	129.3	132.0	132.4	130.4	127.3	124.5	125.7	125.3	
G23.0	122.7	127.0	129.9	130.3	128.0	124.8	121.9	123.0	122.7	
G24.0	119.8	124.4	127.4	127.8	125.4	122.1	118.9	120.4	119.8	
G25.0	117.1	121.8	125.1	125.3	122.8	119.1	116.1	117.3	117.1	
G26.0	114.3	119.2	122.7	122.7	120.1	116.2	113.2	114.6	114.3	
G27.0	111.3	116.1	119.7	119.7	117.1	113.1	110.0	111.5	111.3	
G28.0	108.3	113.4	117.1	116.8	114.2	110.2	107.1	108.5	108.3	
G29.0	105.5	110.2	114.3	113.7	111.0	107.2	103.7	105.4	105.5	
G30.0	102.2	107.3	111.1	110.8	107.9	103.8	100.6	102.1	102.2	
G31.0	99.3	104.4	108.2	107.7	104.9	100.7	97.7	99.2	99.3	
G32.0	95.9	101.1	105.0	104.4	101.6	97.5	94.5	95.9	95.9	
G33.0	93.0	98.2	102.1	101.3	98.7	94.6	91.4	92.8	93.0	
G34.0	90.1	95.2	99.0	98.3	95.7	91.5	88.4	89.9	90.1	
G35.0	86.9	92.1	95.8	95.1	92.5	88.4	85.3	86.6	86.9	
G36.0	83.9	89.2	92.8	92.0	89.5	85.4	82.3	83.7	83.9	

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G37.0	81.1	86.0	89.9	88.7	86.4	82.7	79.2	80.7	81.1	
G38.0	78.0	83.1	86.7	85.8	83.5	79.5	76.5	77.6	78.0	
G39.0	75.3	80.4	84.0	82.9	80.8	76.8	73.7	74.8	75.3	
G40.0	72.2	77.3	80.8	79.8	77.8	73.8	70.8	71.8	72.2	
G41.0	69.6	74.6	78.1	77.0	75.0	71.2	68.1	69.1	69.6	
G42.0	66.9	71.9	75.3	74.3	72.4	68.6	65.5	66.4	66.9	
G43.0	64.2	69.1	72.4	71.4	69.6	65.8	62.8	63.6	64.2	
G44.0	61.6	66.5	69.8	68.8	67.1	63.3	60.3	61.1	61.6	
G45.0	59.1	63.8	67.3	66.0	64.3	60.8	57.6	58.6	59.1	
G46.0	56.5	61.4	64.6	63.5	61.8	58.3	55.3	56.0	56.5	
G47.0	54.3	59.0	62.0	61.1	59.5	55.9	52.9	53.7	54.3	
G48.0	51.7	56.4	59.5	58.4	57.0	53.4	50.5	51.1	51.7	
G49.0	49.6	54.2	57.1	56.1	54.7	51.2	48.4	48.9	49.6	
G50.0	47.4	51.9	54.8	53.9	52.5	49.0	46.2	46.7	47.4	
G51.0	45.0	49.5	52.3	51.5	50.1	46.8	44.0	44.5	45.0	
G52.0	43.0	47.5	50.1	49.3	48.0	44.7	42.0	42.5	43.0	
G53.0	41.0	45.2	48.0	47.0	45.8	42.7	39.8	40.5	41.0	
G54.0	39.0	43.2	45.7	44.9	43.7	40.5	37.8	38.4	39.0	
G55.0	37.1	41.2	43.7	42.9	41.8	38.7	36.0	36.5	37.1	
G56.0	35.1	39.2	41.5	40.8	39.7	36.6	34.0	34.5	35.1	
G57.0	33.4	37.3	39.7	38.8	37.8	34.8	32.2	32.7	33.4	
G58.0	31.6	35.5	37.8	37.0	36.0	33.1	30.5	30.9	31.6	
G59.0	29.8	33.6	35.8	35.1	34.1	31.1	28.7	29.1	29.8	
G60.0	28.1	31.9	34.1	33.3	32.4	29.5	27.0	27.5	28.1	
G61.0	26.6	30.1	32.3	31.5	30.6	27.8	25.3	25.9	26.6	
G62.0	24.8	28.5	30.5	29.8	28.9	26.0	23.8	24.2	24.8	
G63.0	23.3	26.9	28.9	28.2	27.3	24.5	22.3	22.7	23.3	
G64.0	21.7	25.2	27.1	26.5	25.7	22.8	20.8	21.2	21.7	
G65.0	20.3	23.7	25.6	25.0	24.1	21.4	19.3	19.8	20.3	
G66.0	19.0	22.1	24.1	23.3	22.5	20.0	18.0	18.4	19.0	
G67.0	17.5	20.7	22.5	21.9	21.0	18.5	16.6	17.0	17.5	
G68.0	16.2	19.3	21.1	20.5	19.6	17.1	15.3	15.8	16.2	
G69.0	14.9	17.8	19.5	18.9	18.1	15.8	14.0	14.5	14.9	
G70.0	13.7	16.5	18.2	17.6	16.8	14.4	12.8	13.3	13.7	
G71.0	12.5	15.2	16.9	16.3	15.5	13.2	11.6	12.1	12.5	
G72.0	11.3	13.9	15.5	14.9	14.2	11.9	10.4	10.9	11.3	
G73.0	10.2	12.7	14.3	13.7	12.9	10.8	9.3	9.8	10.2	

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector:

HAVIT COMMERCIAL
http://www.havitcommercial.com.au
Tel：02 9381 8383
E-mail:sales@havitcommercial.com.au

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G74.0	9.1	11.5	13.1	12.3	11.7	9.6	8.2	8.8	9.1	
G75.0	8.0	10.3	11.8	11.2	10.5	8.5	7.2	7.7	8.0	
G76.0	7.0	9.3	10.7	10.1	9.4	7.4	6.2	6.7	7.0	
G77.0	6.0	8.2	9.5	8.9	8.2	6.4	5.2	5.7	6.0	
G78.0	5.1	7.2	8.4	7.8	7.2	5.4	4.4	4.9	5.1	
G79.0	4.3	6.2	7.4	6.8	6.2	4.5	3.6	4.1	4.3	
G80.0	3.5	5.2	6.3	5.8	5.2	3.6	2.8	3.2	3.5	
G81.0	2.8	4.4	5.4	4.9	4.3	2.9	2.1	2.5	2.8	
G82.0	2.1	3.5	4.5	4.0	3.4	2.2	1.5	1.9	2.1	
G83.0	1.5	2.8	3.6	3.1	2.7	1.5	0.9	1.3	1.5	
G84.0	1.0	2.1	2.9	2.4	2.0	1.0	0.5	0.8	1.0	
G85.0	0.5	1.5	2.1	1.7	1.4	0.5	0.2	0.4	0.5	
G86.0	0.2	0.9	1.5	1.2	0.9	0.2	0.0	0.1	0.2	
G87.0	0.0	0.6	1.0	0.7	0.5	0.0	0.0	0.0	0.0	
G88.0	0.0	0.2	0.5	0.3	0.2	0.0	0.0	0.0	0.0	
G89.0	0.0	0.0	0.2	0.1	0.0	0.0	0.0	0.0	0.0	
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	

C Plane (°):0.0-360.0: 45.0
Test Lab: Havit Commercial
Test Type: TYPE C
Temperature: 25°C
Operator: DING LI

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 6.583 m
Humidity:
Inspector: