


LUMINAIRE PHOTOMETRIC TEST REPORT


NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 6.62 lm/W
MODEL	HCP-3426251	Imax (cd)	40.11	S/MH(C0/180)	1.30	
NOMINAL POWER(W)	20	LOR(%)	100.0	S/MH(C90/270)	1.33	
RATED VOLTAGE(V)	24	TOTAL FLUX(lm)	132.36	η UP,DN(C0-180)	0.0,51.0	
NOMINAL FLUX(lm)	132.362	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,48.9	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.50	
TEST VOLTAGE(V)	24	η down (%)	100.0	CIBSE SHR MAX	1.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

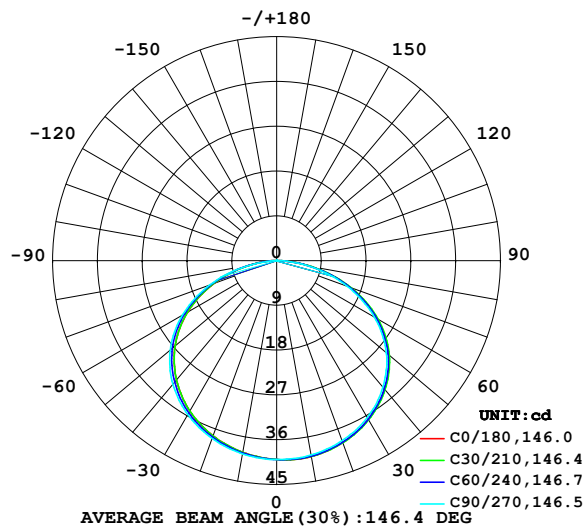

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

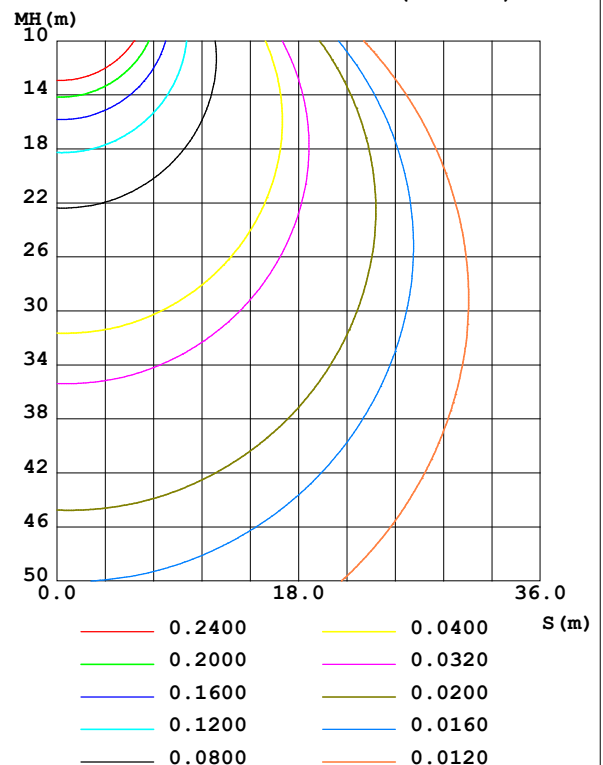

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:JING
 Test Date:2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
 Humidity:65.0%
 Test Distance:6.070m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	39.99	39.94	39.67	39.32	39.12	39.20	39.44	39.73	0- 10	3.796	3.796	2.87,2.87
20	38.89	38.89	38.51	37.86	37.46	37.60	38.01	38.48	10- 20	11.02	14.82	11.2,11.2
30	36.82	36.89	36.44	35.49	34.91	35.13	35.74	36.31	20- 30	17.17	31.99	24.2,24.2
40	33.73	33.77	33.22	32.11	31.32	31.61	32.45	33.11	30- 40	21.57	53.56	40.5,40.5
50	29.40	29.41	28.78	27.69	26.69	27.01	27.93	28.71	40- 50	23.61	77.16	58.3,58.3
60	23.31	23.40	22.70	21.83	20.63	21.02	21.85	22.62	50- 60	22.67	99.83	75.4,75.4
70	15.66	15.75	15.07	14.43	13.34	13.66	14.23	14.96	60- 70	18.34	118.2	89.3,89.3
80	7.015	7.186	6.851	6.434	5.695	5.690	5.410	6.406	70- 80	11.12	129.3	97.7,97.7
90	0.3053	0.2996	0.1388	0.3814	0.3116	0.1315	0	0.2000	80- 90	3.006	132.3	100,100
100	0	0	0	0	0	0	0	0	90-100	0.0257	132.3	100,100
110	0	0	0	0	0	0	0	0	100-110	0	132.3	100,100
120	0	0	0	0	0.0000	0	0	0.0014	110-120	0.0000	132.3	100,100
130	0	0.0029	0.0116	0.0044	0.0087	0.0044	0	0.0029	120-130	0.0013	132.3	100,100
140	0	0.0058	0.0146	0.0088	0.0204	0.0102	0	0.0073	130-140	0.0048	132.3	100,100
150	0	0.0131	0.0262	0.0175	0.0262	0.0218	0.0087	0.0160	140-150	0.0068	132.3	100,100
160	0.0232	0.0204	0.0292	0.0248	0.0291	0.0262	0.0204	0.0233	150-160	0.0096	132.4	100,100
170	0.0262	0.0248	0.0262	0.0277	0.0291	0.0277	0.0262	0.0292	160-170	0.0074	132.4	100,100
180	0.0262	0.0291	0.0262	0.0277	0.0262	0.0277	0.0292	0.0321	170-180	0.0026	132.4	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

0 - 60 DEG Zonal Flux:99.834 %lum: 75.4%

0 - 60 DEG Zonal Flux:99.834 %lum: 75.4%

All measured values may vary less than 35 %

from the average measured value in the 0 to 130 deg. zone: 13.2%

All measured values in the 0 to 130 deg. zone

may vary less than 50% from the average value of itself: 19.5%

C Range: 0 - 360DEG

C Interval: 30.0DEG

Test Speed: HIGH

Temperature:25.3DEG

Operators:JING

Test Date:2022-05-23

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454

Humidity:65.0%

Test Distance:6.070m [K=1.0000]


Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M R.IES

LUMINANCE LIMITATION CURVES

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

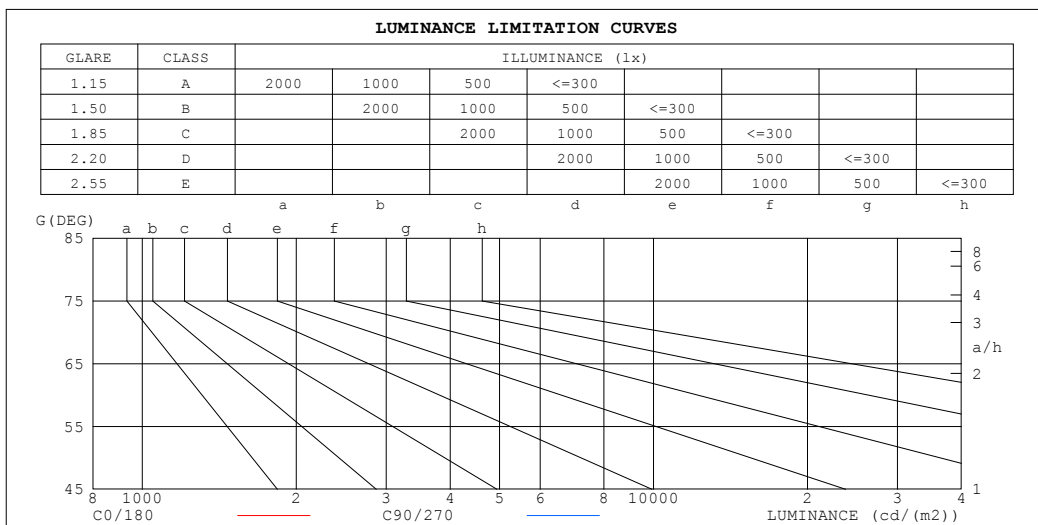

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	318	340
80	405	394
75	441	425
70	459	440
65	466	450
60	467	454
55	464	452
50	458	447
45	450	441


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.03	.98	.94	1.01	.97	.93	.96	.93	.90	.92	.90	.87	.89	.87	.84	.82
2.0	.89	.82	.76	.87	.80	.75	.83	.78	.73	.80	.75	.71	.77	.73	.70	.67
3.0	.77	.69	.62	.76	.68	.61	.73	.66	.60	.70	.64	.59	.67	.62	.58	.56
4.0	.68	.59	.52	.67	.58	.52	.64	.57	.51	.62	.55	.50	.60	.54	.49	.47
5.0	.61	.51	.44	.59	.51	.44	.57	.50	.44	.55	.48	.43	.53	.47	.43	.40
6.0	.54	.45	.38	.53	.45	.38	.52	.44	.38	.50	.43	.37	.48	.42	.37	.35
7.0	.49	.40	.34	.48	.40	.34	.47	.39	.33	.45	.38	.33	.44	.38	.33	.31
8.0	.45	.36	.30	.44	.36	.30	.43	.35	.30	.41	.34	.29	.40	.34	.29	.27
9.0	.41	.32	.27	.40	.32	.27	.39	.32	.27	.38	.31	.26	.37	.31	.26	.24
10.0	.38	.30	.24	.37	.29	.24	.36	.29	.24	.35	.29	.24	.34	.28	.24	.22

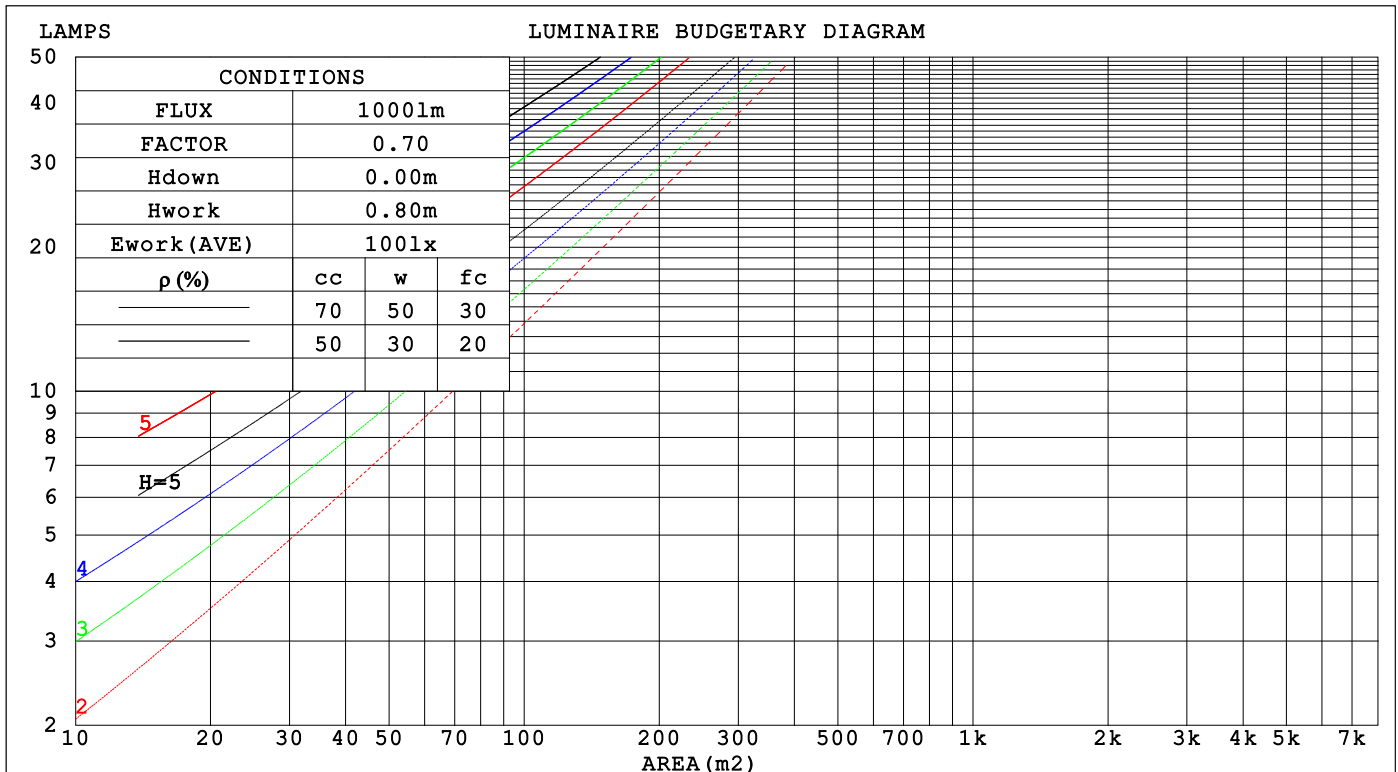

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

WEC AND CCEC

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients (WEC)														
0.0																														
1.0	.327	.186	.059	.320	.183	.058	.307	.176	.056	.294	.170	.055	.283	.164	.053															
2.0	.306	.168	.051	.300	.165	.051	.288	.160	.050	.277	.155	.049	.267	.151	.048															
3.0	.282	.150	.045	.276	.148	.045	.266	.144	.044	.256	.140	.043	.247	.137	.042															
4.0	.259	.135	.040	.254	.133	.039	.245	.130	.039	.236	.127	.038	.228	.124	.038															
5.0	.238	.121	.035	.234	.120	.035	.226	.118	.035	.218	.115	.034	.211	.113	.034															
6.0	.220	.110	.032	.216	.109	.031	.209	.107	.031	.202	.105	.031	.196	.103	.031															
7.0	.205	.101	.029	.201	.100	.029	.194	.098	.028	.188	.097	.028	.182	.095	.028															
8.0	.191	.093	.026	.187	.092	.026	.182	.091	.026	.176	.089	.026	.171	.088	.026															
9.0	.178	.086	.024	.175	.085	.024	.170	.084	.024	.165	.083	.024	.160	.081	.024															
10.0	.167	.080	.022	.165	.080	.022	.160	.078	.022	.155	.077	.022	.151	.076	.022															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.191	.191	.191	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.182	.156	.133	.156	.134	.115	.106	.092	.079	.061	.053	.046	.020	.017	.015	
2.0	.175	.132	.097	.149	.114	.084	.102	.079	.058	.059	.046	.034	.019	.015	.011	
3.0	.167	.115	.073	.143	.099	.063	.098	.069	.044	.057	.040	.026	.018	.013	.009	
4.0	.160	.102	.057	.137	.088	.050	.094	.061	.035	.054	.036	.021	.018	.012	.007	
5.0	.152	.091	.046	.131	.079	.040	.090	.055	.028	.052	.032	.017	.017	.011	.006	
6.0	.145	.083	.039	.125	.072	.034	.086	.050	.024	.050	.030	.014	.016	.010	.005	
7.0	.138	.076	.033	.119	.066	.029	.082	.046	.020	.048	.027	.012	.015	.009	.004	
8.0	.131	.070	.028	.113	.061	.025	.078	.043	.018	.045	.025	.010	.015	.008	.003	
9.0	.125	.065	.025	.108	.057	.022	.075	.040	.016	.043	.024	.009	.014	.008	.003	
10.0	.119	.061	.022	.103	.053	.020	.071	.037	.014	.042	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

NAME: HCP-3426251-1M R					TYPE: 2835 R			WEIGHT:		
SPEC.:					DIM.: 1*0.012			SERIAL No.:		
MFR.: HAVIT COMMERCIAL					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	17.6	19.2	17.9	19.4	19.6	17.5	19.1	17.8	19.3	19.5
3H	19.4	20.9	19.7	21.1	21.4	19.2	20.7	19.6	20.9	21.2
4H	20.2	21.6	20.5	21.8	22.1	20.0	21.4	20.3	21.6	21.9
6H	20.7	22.0	21.0	22.3	22.6	20.5	21.8	20.8	22.1	22.4
8H	20.9	22.1	21.2	22.4	22.7	20.7	22.0	21.0	22.2	22.5
12H	21.0	22.2	21.3	22.5	22.8	20.8	22.0	21.1	22.3	22.6
4H 2H	18.3	19.7	18.7	20.0	20.2	18.2	19.6	18.6	19.9	20.1
3H	20.3	21.5	20.7	21.8	22.1	20.2	21.4	20.5	21.7	22.0
4H	21.2	22.3	21.6	22.6	23.0	21.0	22.1	21.4	22.5	22.8
6H	21.9	22.9	22.3	23.2	23.6	21.7	22.7	22.1	23.0	23.4
8H	22.1	23.0	22.5	23.4	23.8	21.9	22.8	22.3	23.2	23.6
12H	22.2	23.1	22.7	23.5	23.9	22.1	22.9	22.5	23.3	23.7
8H 4H	21.5	22.4	21.9	22.8	23.2	21.4	22.3	21.8	22.7	23.1
6H	22.4	23.1	22.8	23.5	24.0	22.2	23.0	22.6	23.4	23.8
8H	22.7	23.4	23.2	23.8	24.3	22.5	23.2	23.0	23.6	24.1
12H	22.9	23.5	23.4	24.0	24.4	22.8	23.4	23.2	23.8	24.3
12H 4H	21.5	22.4	22.0	22.8	23.2	21.4	22.3	21.8	22.6	23.1
6H	22.4	23.1	22.9	23.6	24.0	22.3	23.0	22.7	23.4	23.9
8H	22.8	23.4	23.3	23.9	24.3	22.7	23.2	23.1	23.7	24.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.2				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.1 / - 0.4					+ 0.2 / - 0.4				

CIE Pub.117, 132.4 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -7.0)
Area: 0.1 m2

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	55	43	36	54	43	36	53	42	36	29
0.80	65	53	45	64	53	45	62	52	45	38
1.00	74	62	54	72	61	54	70	63	54	46
1.25	81	70	62	79	69	62	77	68	61	54
1.50	86	76	68	84	75	68	81	73	67	59
2.00	93	84	77	91	83	77	88	81	75	67
2.50	98	89	83	95	88	82	91	85	80	72
3.00	101	94	88	99	92	87	95	89	85	76
4.00	105	99	94	103	98	93	99	94	90	81
5.00	108	103	98	105	101	97	101	97	94	85
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M R.IES

ISOCANDELA DIAGRAM

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

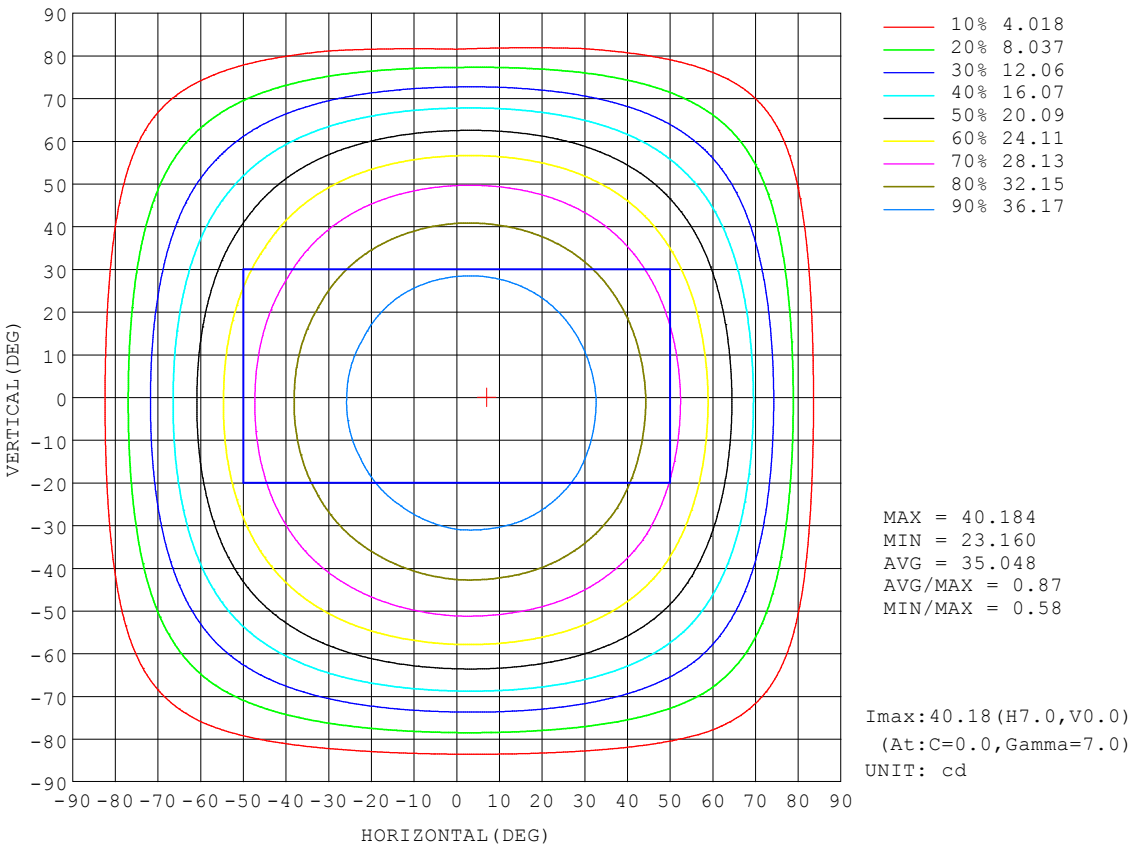


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

AAI Figure

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

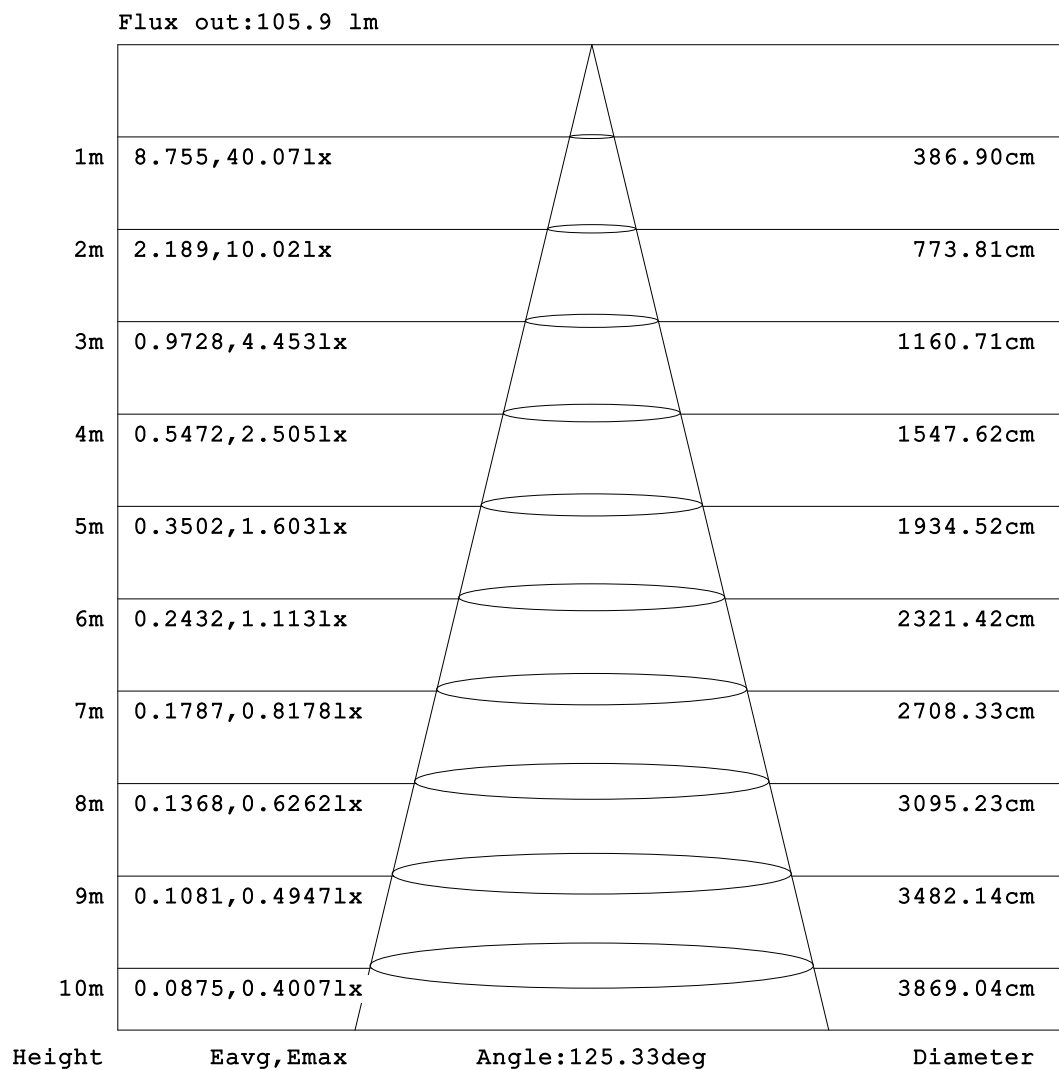

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23


γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M R.IES

ISOLUX DIAGRAM

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

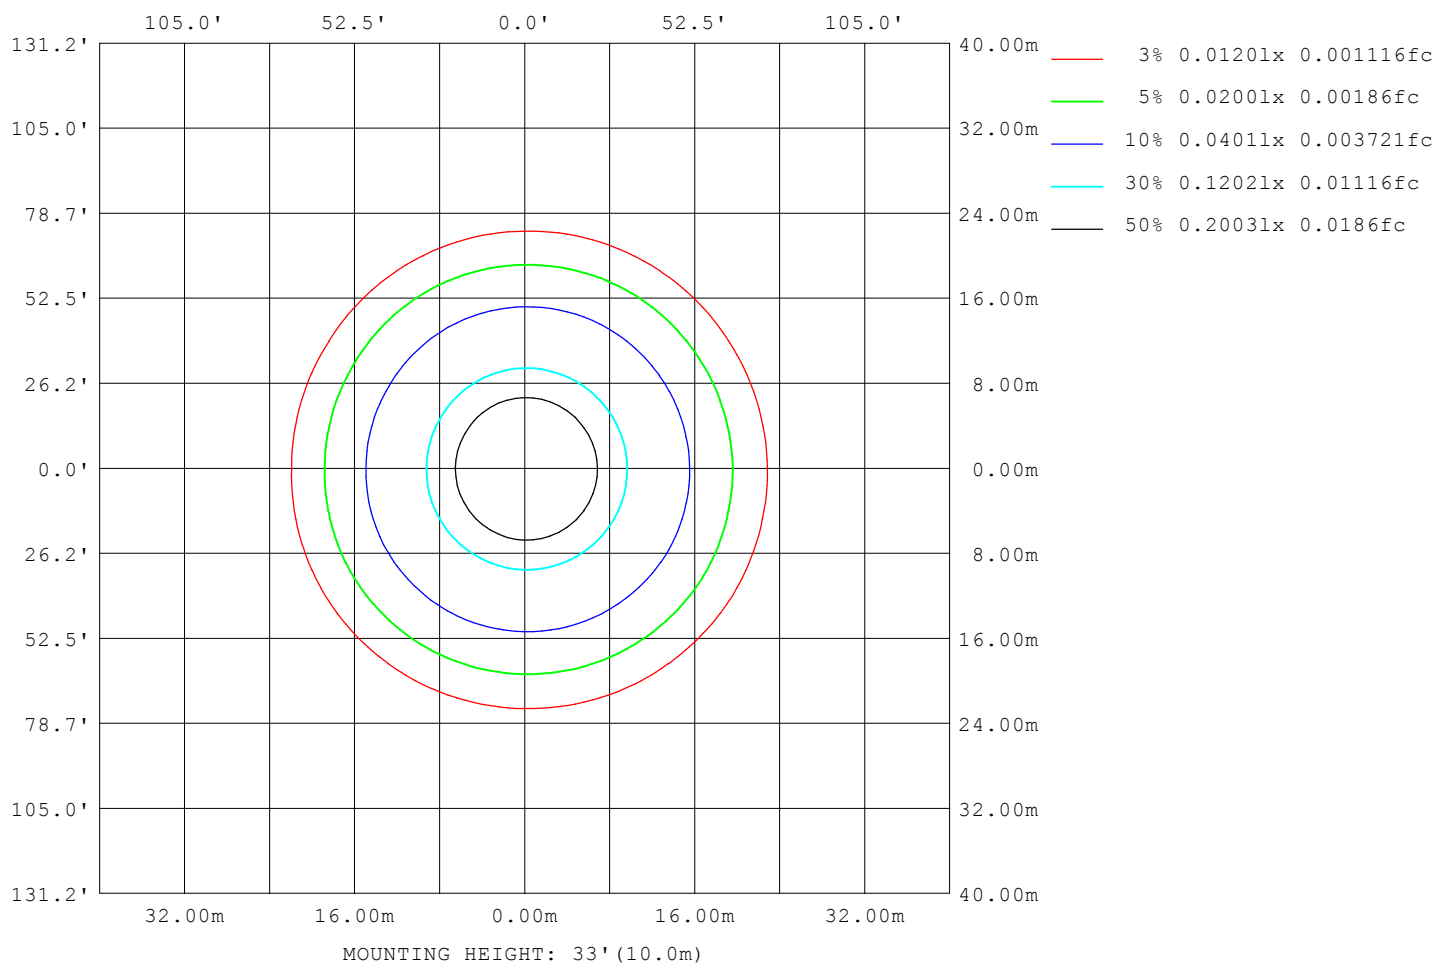

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: JING
 Test Date: 2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
 Humidity: 65.0%
 Test Distance: 6.070m [K=1.0000]
 Remarks:

LED Avg.L Report

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	435
L_0~180 (75) av	404
L_0~180 (85) av	290
L_90~270 (65) av	441
L_90~270 (75) av	408
L_90~270 (85) av	242
L_45 (65) av	441
L_45 (75) av	411
L_45 (85) av	295

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

Planar Illuminance Curve

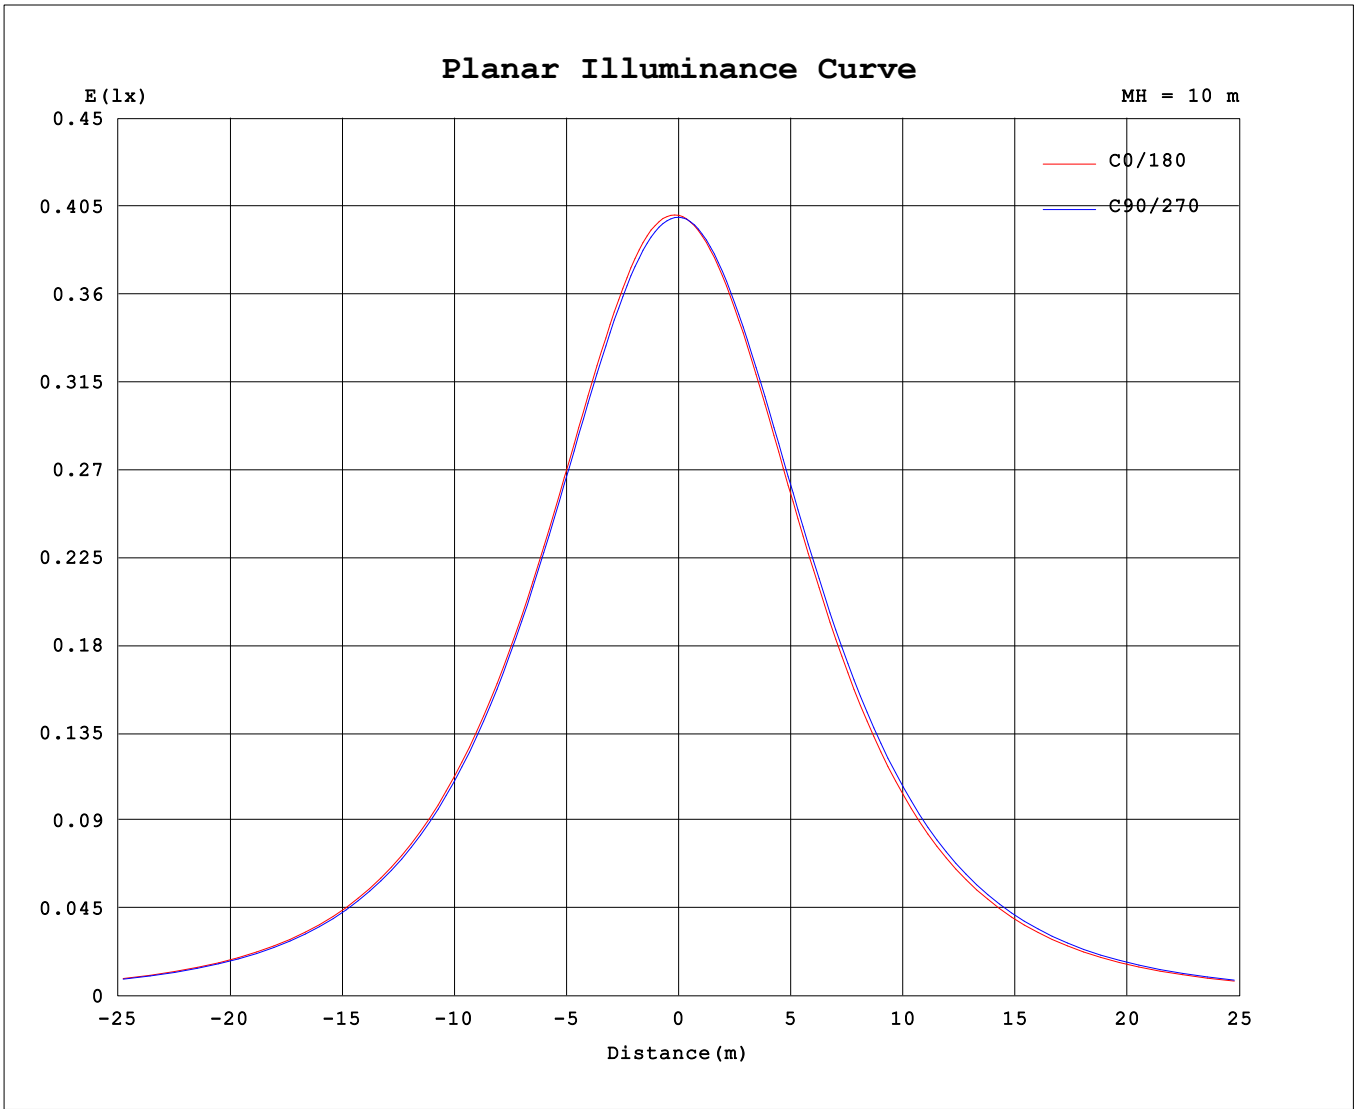

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 30.0DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Temperature:25.3DEG	Humidity:65.0%
Operators:JING	Test Distance:6.070m [K=1.0000]
Test Date:2022-05-23	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: HCP-3426251-1M R	TYPE: 2835 R	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330							
0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0							
5	40.1	40.1	40.0	39.9	39.8	39.7	39.6	39.6	39.7	39.8	39.9	40.0							
10	40.0	40.0	39.9	39.7	39.4	39.2	39.1	39.1	39.3	39.4	39.6	39.8							
15	39.6	39.6	39.5	39.2	38.9	38.5	38.4	38.4	38.6	38.8	39.1	39.3							
20	38.9	38.9	38.8	38.5	38.1	37.7	37.5	37.5	37.7	38.0	38.3	38.6							
25	38.0	38.1	38.0	37.6	37.0	36.6	36.3	36.3	36.7	37.0	37.4	37.7							
30	36.8	37.0	36.8	36.4	35.8	35.2	34.9	34.9	35.3	35.7	36.1	36.5							
35	35.4	35.6	35.4	35.0	34.2	33.6	33.2	33.2	33.8	34.2	34.7	35.0							
40	33.7	33.9	33.7	33.2	32.5	31.8	31.3	31.3	31.9	32.5	32.9	33.3							
45	31.8	31.9	31.6	31.2	30.4	29.7	29.2	29.1	29.8	30.4	30.9	31.3							
50	29.4	29.6	29.2	28.8	28.0	27.3	26.7	26.7	27.4	27.9	28.5	28.9							
55	26.6	26.8	26.4	26.0	25.3	24.6	23.8	23.9	24.6	25.1	25.7	26.1							
60	23.3	23.6	23.2	22.7	22.1	21.5	20.6	20.7	21.4	21.8	22.4	22.8							
65	19.6	19.9	19.6	19.0	18.6	18.0	17.1	17.2	17.8	18.2	18.8	19.1							
70	15.7	15.9	15.6	15.1	14.7	14.2	13.3	13.4	13.9	14.2	14.8	15.2							
75	11.4	11.7	11.4	11.0	10.7	10.3	9.50	9.54	9.83	10.1	10.5	10.9							
80	7.01	7.32	7.06	6.85	6.57	6.30	5.69	5.61	5.77	5.41	6.23	6.58							
85	2.76	3.12	2.98	2.97	2.77	2.69	2.29	2.01	1.99	1.25	2.31	2.46							
90	0.31	0.33	0.27	0.14	0.36	0.41	0.31	0.16	0.10	0.00	0.16	0.24							
95	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
105	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00							
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00							
130	0.00	0.01	0.00	0.01	0.00	0.01	0.01	0.00	0.01	0.00	0.01	0.00							
135	0.00	0.01	0.00	0.01	0.00	0.01	0.01	0.00	0.01	0.00	0.01	0.00							
140	0.00	0.01	0.00	0.01	0.00	0.02	0.02	0.00	0.02	0.00	0.01	0.00							
145	0.00	0.02	0.00	0.02	0.00	0.02	0.02	0.01	0.02	0.00	0.02	0.00							
150	0.00	0.02	0.01	0.03	0.01	0.02	0.03	0.01	0.03	0.01	0.02	0.01							
155	0.01	0.02	0.01	0.03	0.02	0.03	0.03	0.02	0.03	0.02	0.02	0.01							
160	0.02	0.03	0.01	0.03	0.02	0.03	0.03	0.02	0.03	0.02	0.03	0.02							
165	0.02	0.03	0.02	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.03	0.03							
170	0.03	0.03	0.02	0.03	0.03	0.03	0.03	0.02	0.03	0.03	0.03	0.03							
175	0.03	0.03	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03							
180	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03							

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks: