


LUMINAIRE PHOTOMETRIC TEST REPORT


NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 96.97 lm/W
MODEL	HCP-3426251	Imax (cd)	161.8	S/MH(C0/180)	1.26	
NOMINAL POWER(W)	20	LOR(%)	100.0	S/MH(C90/270)	1.29	
RATED VOLTAGE(V)	24	TOTAL FLUX(lm)	478.08	η UP,DN(C0-180)	0.1,49.1	
NOMINAL FLUX(lm)	478.08	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.2,50.6	
LAMPS INSIDE	1	η up (%)	0.3	CIBSE SHR NOM	1.25	
TEST VOLTAGE(V)	24	η down (%)	99.7	CIBSE SHR MAX	1.35	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

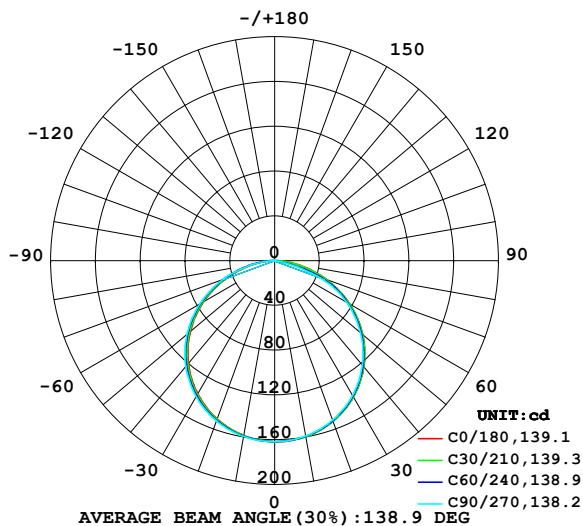

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

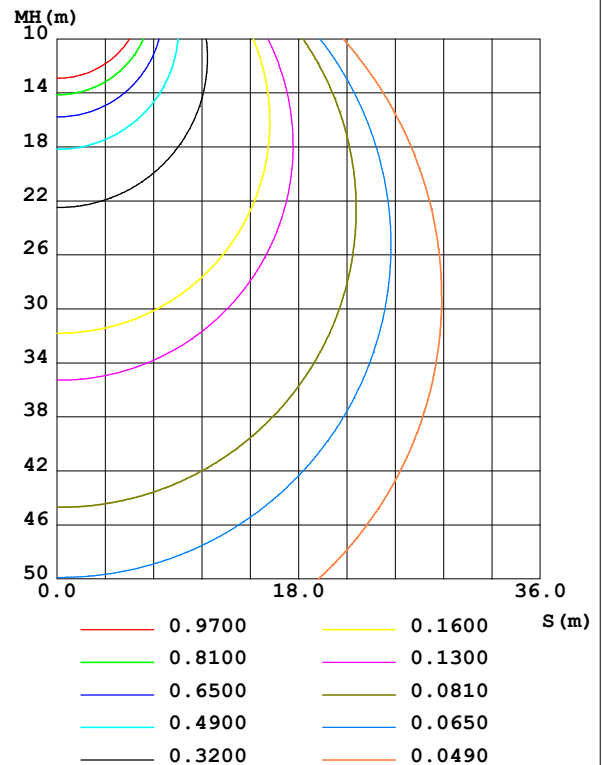

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	159.8	159.5	159.1	158.7	158.6	158.9	159.5	159.8	0- 10	15.32	15.32	3.2,3.2
20	152.7	152.4	151.6	150.8	150.4	151.3	152.3	152.9	10- 20	44.09	59.41	12.4,12.4
30	140.7	140.3	139.2	138.0	137.4	138.8	140.3	141.0	20- 30	67.42	126.8	26.5,26.5
40	123.9	123.3	121.9	120.6	119.9	121.6	123.5	124.4	30- 40	82.28	209.1	43.7,43.7
50	102.7	101.9	100.0	98.81	98.36	100.3	102.2	103.4	40- 50	86.55	295.7	61.8,61.8
60	77.45	76.39	74.34	73.27	72.93	75.03	77.01	78.23	50- 60	79.27	374.9	78.4,78.4
70	49.23	46.85	39.84	44.21	45.21	47.27	49.10	50.25	60- 70	60.90	435.8	91.2,91.2
80	20.99	12.30	2.226	13.64	18.11	20.33	19.51	22.58	70- 80	32.78	468.6	98,98
90	2.058	0.9571	0.0233	0.8886	1.492	2.657	0.0178	2.983	80- 90	8.185	476.8	99.7,99.7
100	0.1080	0.0481	0.0525	0.0495	0.0611	0.0776	0.0204	0.1022	90-100	0.5801	477.4	99.9,99.9
110	0.0583	0.0699	0.0875	0.0728	0.0845	0.0729	0.0611	0.0684	100-110	0.0626	477.4	99.9,99.9
120	0.0787	0.1092	0.1225	0.1136	0.1224	0.1107	0.0961	0.0961	110-120	0.0851	477.5	99.9,99.9
130	0.1223	0.1399	0.1575	0.1485	0.1603	0.1428	0.1282	0.1397	120-130	0.1126	477.6	99.9,99.9
140	0.1602	0.1734	0.1924	0.1820	0.1953	0.1822	0.1661	0.1762	130-140	0.1251	477.8	99.9,99.9
150	0.2097	0.2113	0.2245	0.2141	0.2302	0.2201	0.2070	0.2140	140-150	0.1239	477.9	100,100
160	0.2243	0.2346	0.2508	0.2388	0.2564	0.2376	0.2216	0.2344	150-160	0.1039	478.0	100,100
170	0.2535	0.2550	0.2624	0.2548	0.2564	0.2565	0.2508	0.2548	160-170	0.0701	478.1	100,100
180	0.2593	0.2565	0.2624	0.2562	0.2564	0.2594	0.2536	0.2562	170-180	0.0244	478.1	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

0 - 60 DEG Zonal Flux:374.93 %lum: 78.4%
0 - 60 DEG Zonal Flux:374.93 %lum: 78.4%
All measured values may vary less than 35 %
from the average measured value in the 0 to 130 deg. zone: 13.4%
All measured values in the 0 to 130 deg. zone
may vary less than 50% from the average value of itself: 19.2%


C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 30.0DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Temperature:25.3DEG	Humidity:65.0%
Operators:JING	Test Distance:6.070m [K=1.0000]
Test Date:2022-05-23	Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M W.IES

LUMINANCE LIMITATION CURVES

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

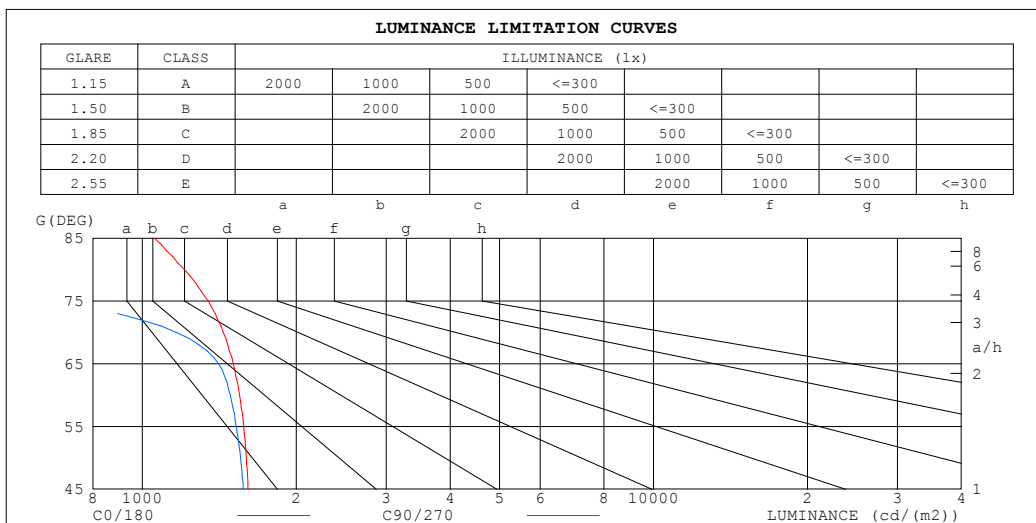

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1056	14
80	1209	128
75	1346	675
70	1440	1164
65	1505	1408
60	1549	1486
55	1579	1528
50	1597	1555
45	1609	1575


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

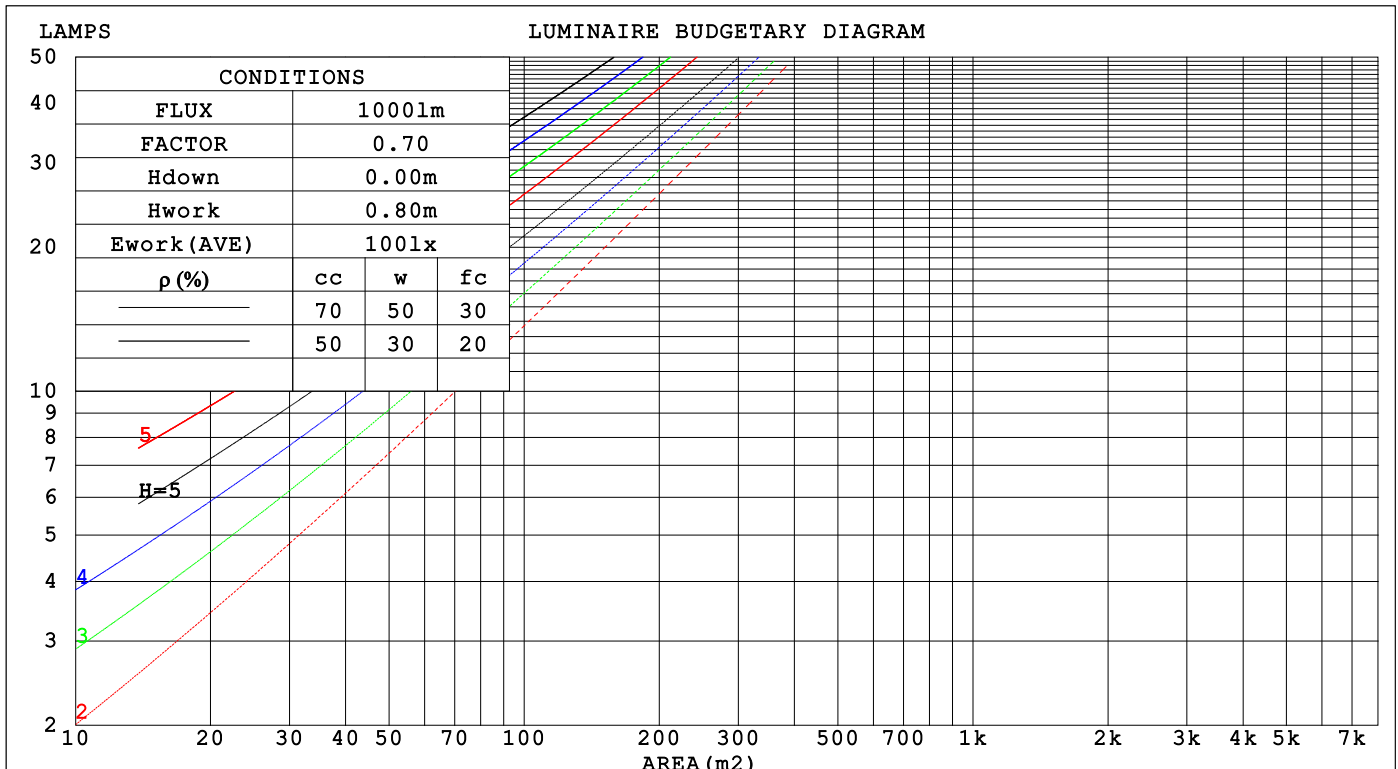

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

WEC AND CCEC

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.309	.176	.056	.302	.172	.055	.289	.166	.053	.276	.159	.051	.265	.154	.050															
2.0	.292	.160	.049	.286	.157	.049	.274	.152	.047	.263	.148	.046	.253	.143	.045															
3.0	.271	.144	.043	.265	.142	.043	.255	.138	.042	.245	.134	.041	.236	.131	.040															
4.0	.250	.130	.038	.245	.128	.038	.236	.125	.037	.227	.122	.037	.219	.119	.036															
5.0	.231	.118	.034	.227	.117	.034	.219	.114	.034	.211	.111	.033	.204	.109	.033															
6.0	.215	.108	.031	.211	.106	.031	.203	.104	.030	.196	.102	.030	.190	.100	.030															
7.0	.200	.099	.028	.196	.098	.028	.190	.096	.028	.183	.094	.027	.178	.092	.027															
8.0	.186	.091	.026	.183	.090	.026	.177	.089	.025	.172	.087	.025	.167	.086	.025															
9.0	.175	.085	.024	.172	.084	.024	.167	.082	.023	.162	.081	.023	.157	.080	.023															
10.0	.164	.079	.022	.162	.078	.022	.157	.077	.022	.152	.076	.022	.148	.075	.021															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.193	.193	.193	.165	.165	.165	.112	.112	.112	.065	.065	.065	.021	.021	.021	
1.0	.182	.158	.136	.156	.136	.117	.107	.093	.081	.061	.054	.047	.020	.017	.015	
2.0	.174	.134	.100	.149	.115	.086	.102	.080	.060	.059	.046	.035	.019	.015	.012	
3.0	.167	.116	.076	.143	.100	.066	.098	.070	.046	.057	.041	.027	.018	.013	.009	
4.0	.159	.103	.060	.137	.089	.052	.094	.062	.037	.054	.036	.022	.017	.012	.007	
5.0	.152	.093	.049	.130	.080	.043	.090	.056	.030	.052	.033	.018	.017	.011	.006	
6.0	.145	.084	.041	.124	.073	.036	.086	.051	.025	.050	.030	.015	.016	.010	.005	
7.0	.138	.078	.035	.119	.067	.031	.082	.047	.022	.048	.028	.013	.015	.009	.004	
8.0	.131	.072	.031	.113	.062	.027	.078	.044	.019	.046	.026	.011	.015	.008	.004	
9.0	.125	.067	.027	.108	.058	.024	.075	.041	.017	.044	.024	.010	.014	.008	.003	
10.0	.120	.062	.024	.103	.054	.021	.072	.038	.015	.042	.023	.009	.014	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

NAME: HCP-3426251-1M W						TYPE: 2216 W			WEIGHT:		
SPEC.:						DIM.: 1*0.012			SERIAL No.:		
MFR.: HAVIT COMMERCIAL						SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	17.2	18.7	17.4	18.9	19.1	17.0	18.5	17.3	18.7	18.9	
3H	18.7	20.2	19.1	20.4	20.6	18.3	19.7	18.6	20.0	20.2	
4H	19.4	20.7	19.7	21.0	21.2	18.6	19.9	18.9	20.2	20.4	
6H	19.8	21.1	20.2	21.4	21.7	18.5	19.8	18.9	20.1	20.3	
8H	20.0	21.2	20.3	21.5	21.8	18.5	19.7	18.8	20.0	20.3	
12H	20.1	21.2	20.4	21.5	21.8	18.4	19.6	18.8	19.9	20.2	
4H 2H	17.8	19.1	18.1	19.4	19.6	17.6	19.0	18.0	19.2	19.5	
3H	19.5	20.7	19.9	21.0	21.3	19.1	20.3	19.5	20.6	20.9	
4H	20.3	21.4	20.7	21.7	22.0	19.4	20.5	19.8	20.8	21.2	
6H	20.9	21.8	21.3	22.2	22.5	19.4	20.4	19.8	20.7	21.1	
8H	21.1	21.9	21.5	22.3	22.7	19.4	20.3	19.8	20.6	21.0	
12H	21.2	22.0	21.6	22.4	22.8	19.3	20.1	19.8	20.5	20.9	
8H 4H	20.5	21.4	20.9	21.7	22.1	19.7	20.5	20.1	20.9	21.3	
6H	21.2	21.9	21.6	22.3	22.7	19.7	20.4	20.1	20.8	21.2	
8H	21.4	22.1	21.9	22.5	23.0	19.6	20.3	20.1	20.7	21.2	
12H	21.6	22.2	22.1	22.6	23.1	19.6	20.2	20.1	20.6	21.1	
12H 4H	20.4	21.2	20.9	21.6	22.0	19.7	20.5	20.1	20.9	21.3	
6H	21.1	21.8	21.6	22.2	22.7	19.7	20.4	20.2	20.8	21.2	
8H	21.4	22.0	21.9	22.5	22.9	19.7	20.2	20.2	20.7	21.2	
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H	+ 0.2 / - 0.2					+ 0.2 / - 0.3					
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.4					
2.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.4					

CIE Pub.117, 478.1 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -2.6)
Area: 0.1 m2

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	57	45	38	56	45	38	55	44	38	31
0.80	67	55	48	66	55	48	64	54	47	40
1.00	76	64	57	74	64	57	72	65	56	49
1.25	83	72	65	81	71	65	79	70	64	56
1.50	88	78	71	86	77	70	83	75	69	62
2.00	95	86	80	93	85	79	89	83	77	69
2.50	99	91	85	97	89	84	93	87	82	74
3.00	102	95	90	100	94	89	96	91	86	78
4.00	106	100	96	104	99	94	99	95	92	83
5.00	109	104	100	106	102	98	102	98	95	86
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M W.IES

ISOCANDELA DIAGRAM

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

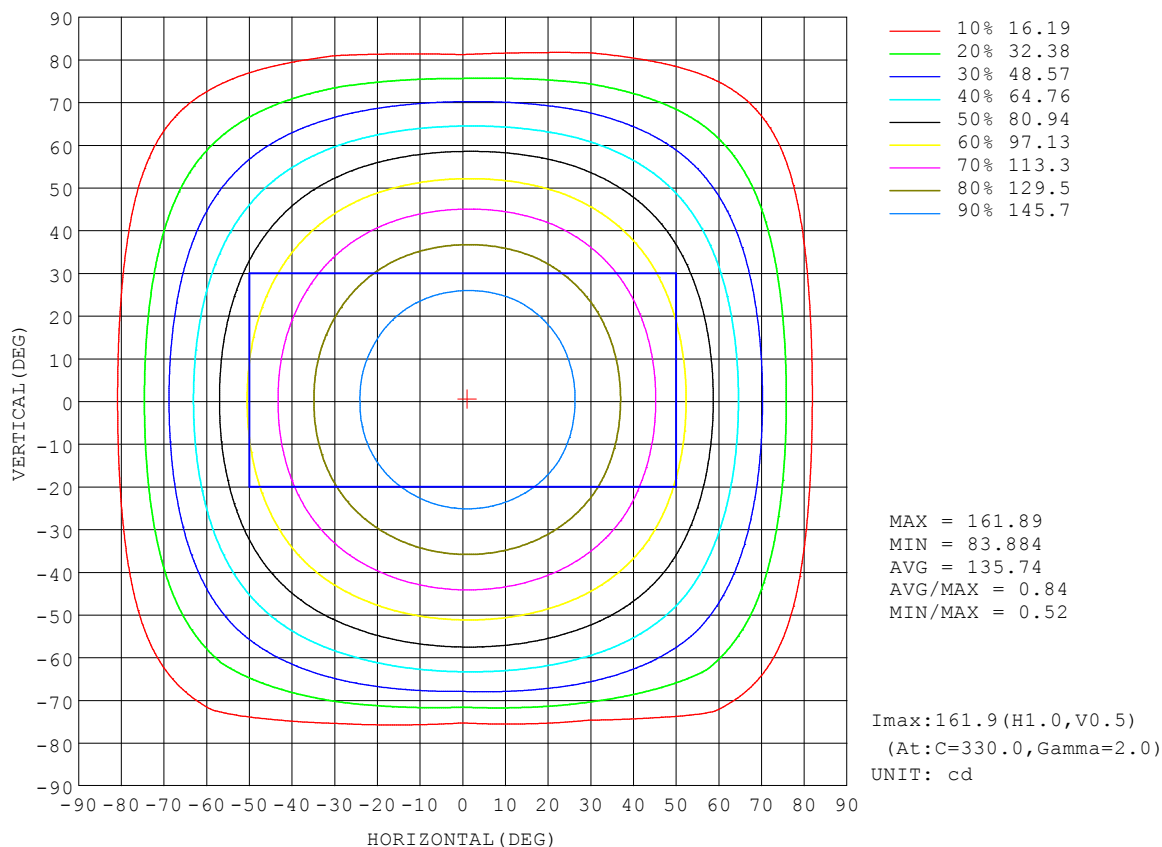


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

AAI Figure

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

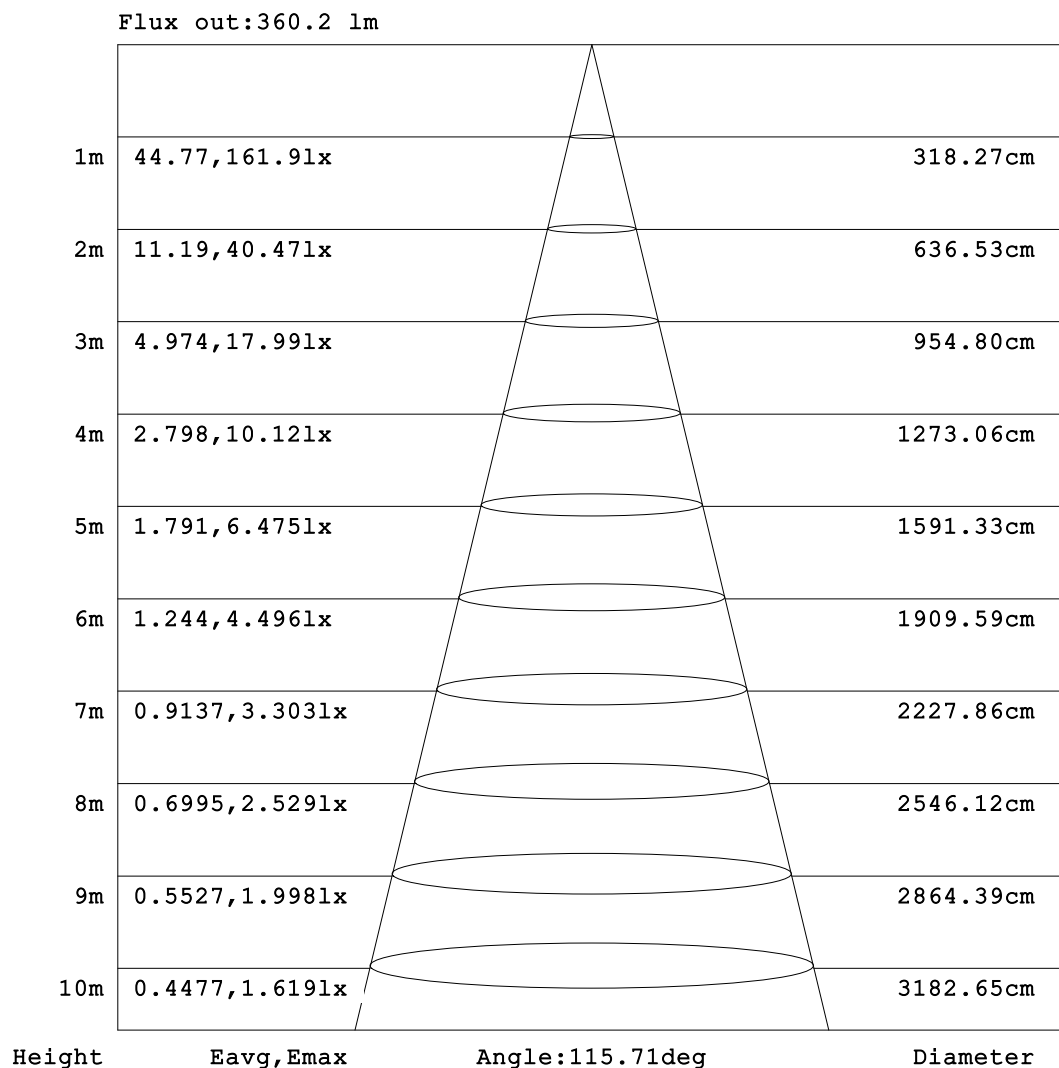

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23


γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks:

IES Flood Report

Photometric Filename: HCP-3426251-1M W.IES

ISOLUX DIAGRAM

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

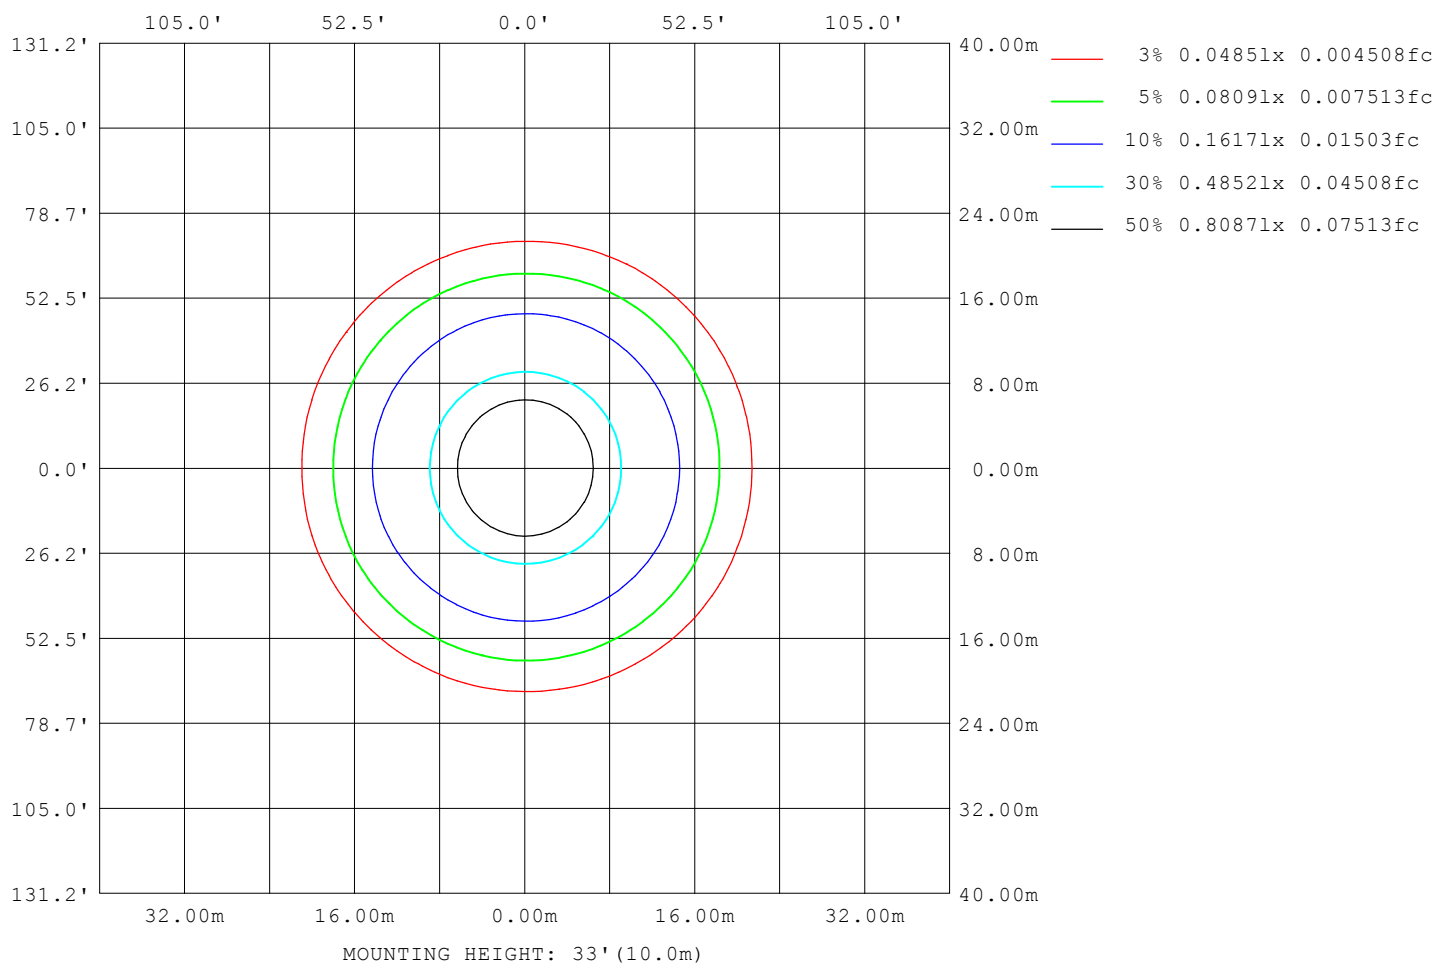

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: JING
 Test Date: 2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
 Humidity: 65.0%
 Test Distance: 6.070m [K=1.0000]
 Remarks:

LED Avg.L Report

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	1454
L_0~180 (75) av	1275
L_0~180 (85) av	952
L_90~270 (65) av	1453
L_90~270 (75) av	1000
L_90~270 (85) av	389
L_45 (65) av	1465
L_45 (75) av	1229
L_45 (85) av	867

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

Planar Illuminance Curve

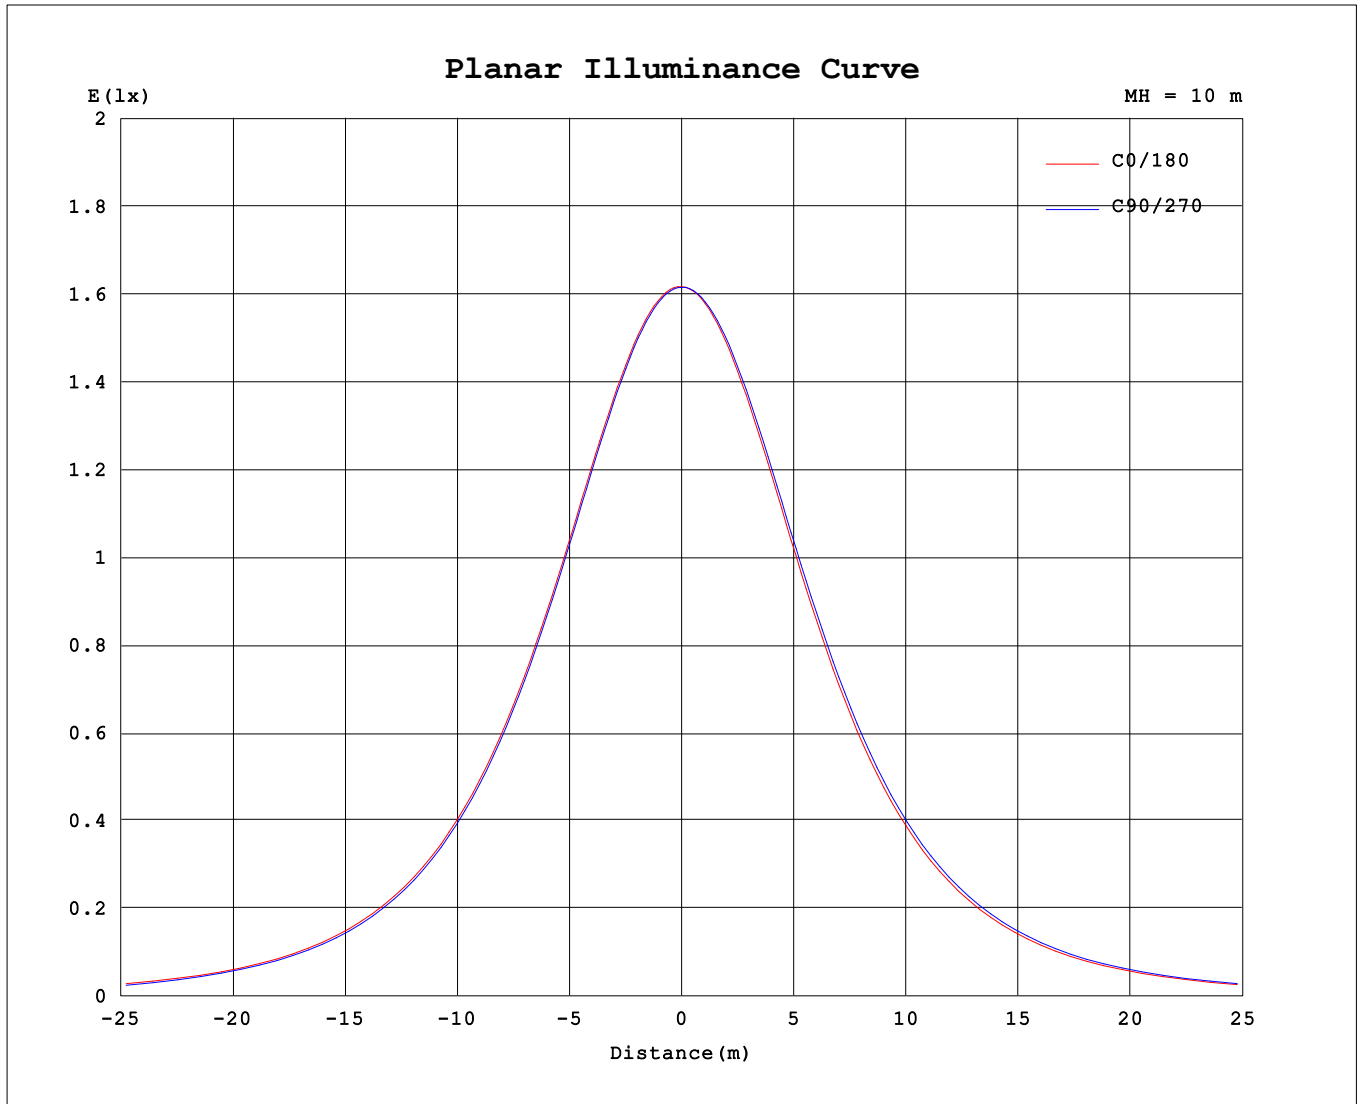

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JING
Test Date: 2022-05-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity: 65.0%
Test Distance: 6.070m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: HCP-3426251-1M W	TYPE: 2216 W	WEIGHT:
SPEC.:	DIM.: 1*0.012	SERIAL No.:
MFR.: HAVIT COMMERCIAL	SUR.:	Shielding Angle:

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330							
0	162	162	162	162	162	162	162	162	162	162	162	162							
5	161	161	161	161	161	161	161	161	161	161	161	161							
10	160	160	159	159	159	159	159	159	159	160	160	160							
15	157	157	156	156	155	155	155	155	156	157	157	157							
20	153	153	152	152	151	151	150	151	152	152	153	153							
25	147	147	147	146	145	145	145	145	146	147	148	148							
30	141	141	140	139	138	138	137	138	139	140	141	141							
35	133	133	132	131	130	130	129	130	131	132	133	133							
40	124	124	123	122	121	120	120	121	122	124	124	124							
45	114	114	113	111	110	110	110	111	112	113	115	114							
50	103	103	101	100	98.9	98.7	98.4	99.3	101	102	104	103							
55	90.6	90.4	88.9	87.7	86.6	86.5	86.0	87.1	89.0	90.1	91.4	91.2							
60	77.4	77.3	75.5	74.3	73.2	73.3	72.9	74.1	75.9	77.0	78.3	78.2							
65	63.6	63.3	61.4	59.6	59.1	59.5	59.3	60.4	62.3	63.3	64.6	64.4							
70	49.2	48.8	44.9	39.8	43.1	45.3	45.2	46.3	48.2	49.1	50.4	50.1							
75	34.8	34.4	23.6	17.5	24.5	31.4	31.2	32.4	34.2	34.3	36.2	35.8							
80	21.0	19.4	5.16	2.23	8.84	18.4	18.1	19.5	21.2	19.5	22.9	22.3							
85	9.20	7.76	0.45	0.12	2.37	7.61	7.39	8.75	10.2	6.66	11.2	10.6							
90	2.06	1.67	0.24	0.02	0.45	1.32	1.49	2.35	2.96	0.02	3.09	2.88							
95	0.49	0.30	0.07	0.03	0.07	0.43	0.52	0.97	0.48	0.01	0.53	0.91							
100	0.11	0.05	0.04	0.05	0.04	0.06	0.06	0.11	0.05	0.02	0.04	0.16							
105	0.06	0.06	0.04	0.07	0.04	0.06	0.06	0.06	0.06	0.03	0.06	0.07							
110	0.06	0.08	0.06	0.09	0.06	0.08	0.08	0.06	0.08	0.06	0.08	0.06							
115	0.07	0.09	0.07	0.10	0.08	0.10	0.10	0.07	0.10	0.07	0.10	0.06							
120	0.08	0.12	0.10	0.12	0.11	0.12	0.12	0.10	0.12	0.10	0.11	0.08							
125	0.11	0.13	0.12	0.14	0.11	0.14	0.14	0.11	0.14	0.12	0.14	0.12							
130	0.12	0.15	0.13	0.16	0.13	0.16	0.16	0.13	0.16	0.13	0.15	0.13							
135	0.15	0.17	0.15	0.17	0.15	0.18	0.18	0.16	0.18	0.16	0.17	0.15							
140	0.16	0.19	0.16	0.19	0.17	0.20	0.20	0.17	0.20	0.17	0.19	0.16							
145	0.18	0.20	0.18	0.21	0.20	0.21	0.22	0.20	0.21	0.19	0.20	0.18							
150	0.21	0.22	0.20	0.22	0.21	0.22	0.23	0.21	0.23	0.21	0.22	0.21							
155	0.21	0.23	0.21	0.24	0.21	0.24	0.25	0.21	0.24	0.21	0.23	0.21							
160	0.22	0.25	0.22	0.25	0.22	0.25	0.26	0.22	0.25	0.22	0.25	0.22							
165	0.24	0.26	0.24	0.26	0.24	0.26	0.26	0.24	0.26	0.24	0.26	0.23							
170	0.25	0.26	0.25	0.26	0.25	0.26	0.26	0.25	0.26	0.25	0.26	0.25							
175	0.25	0.26	0.25	0.26	0.25	0.26	0.26	0.26	0.26	0.25	0.26	0.25							
180	0.26	0.26	0.25	0.26	0.26	0.26	0.26	0.26	0.26	0.25	0.26	0.25							

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JING
Test Date:2022-05-23

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.454
Humidity:65.0%
Test Distance:6.070m [K=1.0000]
Remarks: