
LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:


DATA OF LAMP		PHOTOMETRIC DATA		Eff: 58.26 lm/W	
MODEL	5000K	Imax(cd)	281.7	S/MH(C0/180)	1.41
NOMINAL POWER(W)	19.2	LOR(%)	100.0	S/MH(C90/270)	1.39
RATED VOLTAGE(V)	24	TOTAL FLUX(lm)	1090.5	η UP,DN(C0-180)	0.0,49.8
NOMINAL FLUX(lm)	1090.54	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.2
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	1.50
TEST VOLTAGE(V)	0.0	η down(%)	100.0	CIBSE SHR MAX	1.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

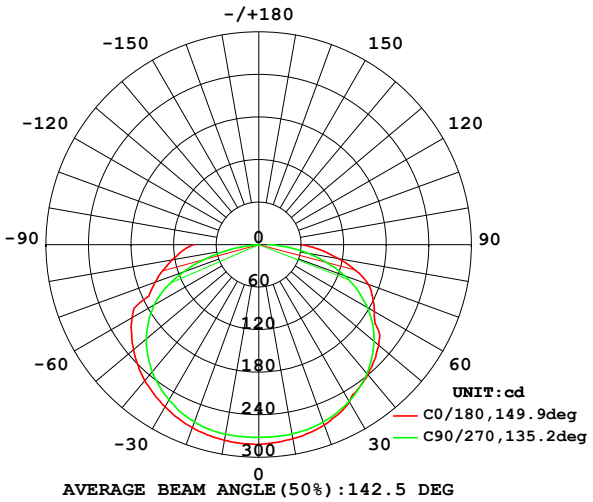

AVERAGE BEAM ANGLE(50%):142.5 DEG

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

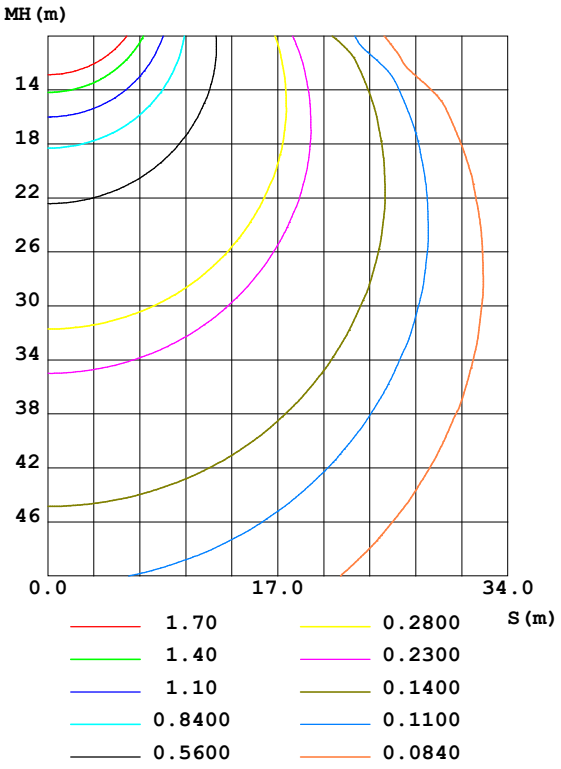

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C90	C180	C270					γ	Φ zone	Φ total	%lum,lamp
10	280.0	271.4	278.0	271.1					0- 10	26.33	26.33	2.41,2.41
20	274.6	265.9	270.6	266.1					10- 20	77.22	103.5	9.49,9.49
30	264.3	253.0	255.8	255.1					20- 30	121.9	225.5	20.7,20.7
40	250.3	233.8	239.3	237.6					30- 40	156.0	381.5	35,35
50	230.4	207.2	221.0	212.1					40- 50	177.4	558.9	51.3,51.3
60	206.3	170.4	188.3	176.9					50- 60	181.0	739.9	67.9,67.9
70	155.5	113.1	164.7	128.9					60- 70	162.0	902.0	82.7,82.7
80	123.9	41.14	114.0	69.66					70- 80	121.0	1023	93.8,93.8
90	91.69	1.666	60.79	13.52					80- 90	67.53	1091	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		


C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	.00	.95	.90	.98	.93	.88	.93	.89	.85	.89	.86	.83	.85	.83	.80	.78
2.0	.85	.77	.70	.83	.76	.70	.80	.73	.68	.76	.71	.66	.73	.69	.65	.62
3.0	.74	.64	.57	.72	.63	.56	.69	.61	.55	.66	.60	.54	.63	.58	.53	.51
4.0	.65	.55	.47	.63	.54	.47	.60	.52	.46	.58	.51	.45	.56	.50	.45	.42
5.0	.57	.47	.40	.56	.47	.40	.54	.46	.39	.52	.44	.39	.50	.43	.38	.36
6.0	.51	.41	.34	.50	.41	.34	.48	.40	.34	.46	.39	.34	.45	.38	.33	.31
7.0	.46	.37	.30	.45	.36	.30	.44	.36	.30	.42	.35	.29	.41	.34	.29	.27
8.0	.42	.33	.27	.41	.32	.26	.40	.32	.26	.38	.31	.26	.37	.31	.26	.24
9.0	.38	.30	.24	.38	.29	.24	.36	.29	.23	.35	.28	.23	.34	.28	.23	.21
10.0	.35	.27	.21	.35	.27	.21	.34	.26	.21	.33	.26	.21	.32	.25	.21	.19

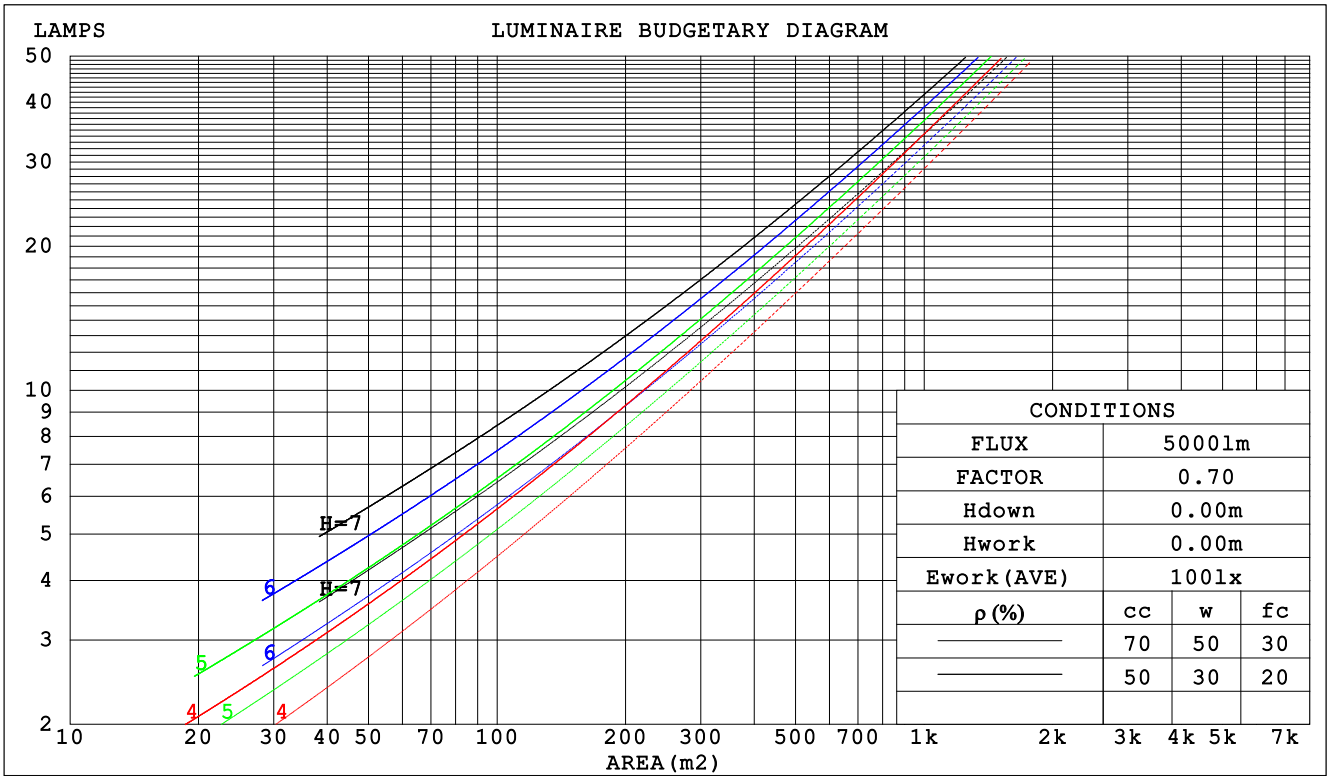

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coeffcients(WEC)									
0.0																
1.0	.385	.219	.069	.378	.215	.068	.364	.209	.067	.351	.203	.065	.340	.197	.064	
2.0	.342	.187	.057	.335	.185	.057	.323	.180	.056	.312	.175	.055	.301	.171	.054	
3.0	.306	.163	.049	.301	.161	.048	.290	.157	.048	.280	.153	.047	.271	.150	.046	
4.0	.277	.144	.042	.272	.142	.042	.262	.139	.042	.253	.136	.041	.245	.133	.041	
5.0	.252	.128	.037	.247	.127	.037	.239	.124	.037	.231	.122	.036	.224	.120	.036	
6.0	.231	.116	.033	.227	.115	.033	.219	.112	.033	.212	.110	.032	.206	.108	.032	
7.0	.213	.105	.030	.209	.104	.030	.203	.102	.030	.196	.101	.029	.190	.099	.029	
8.0	.197	.096	.027	.194	.096	.027	.188	.094	.027	.183	.093	.027	.177	.091	.027	
9.0	.184	.089	.025	.181	.088	.025	.176	.087	.025	.171	.086	.024	.166	.084	.024	
10.0	.172	.082	.023	.169	.082	.023	.165	.081	.023	.160	.079	.023	.156	.078	.022	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.185	.155	.128	.159	.133	.111	.109	.092	.076	.062	.053	.044	.020	.017	.014	
2.0	.179	.132	.092	.153	.113	.080	.105	.078	.055	.061	.046	.033	.019	.015	.011	
3.0	.171	.115	.069	.147	.099	.060	.101	.069	.042	.058	.040	.025	.019	.013	.008	
4.0	.164	.102	.054	.140	.088	.047	.097	.061	.033	.056	.036	.020	.018	.012	.006	
5.0	.156	.091	.044	.134	.079	.038	.092	.055	.027	.053	.032	.016	.017	.011	.005	
6.0	.148	.083	.037	.127	.072	.032	.088	.050	.023	.051	.030	.013	.016	.010	.004	
7.0	.141	.076	.031	.121	.066	.027	.084	.046	.019	.049	.027	.011	.016	.009	.004	
8.0	.134	.071	.027	.115	.061	.024	.080	.043	.017	.046	.025	.010	.015	.008	.003	
9.0	.127	.066	.024	.110	.057	.021	.076	.040	.015	.044	.024	.009	.014	.008	.003	
10.0	.121	.061	.022	.104	.053	.019	.072	.037	.013	.042	.022	.008	.014	.007	.003	

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

Uncorrected UGR Table

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

ceiling/cavity		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H	y = 2H	26.6	28.3	26.9	28.5	28.7	26.0	27.6	26.2	27.8	28.0
	3H	28.8	30.3	29.1	30.6	30.8	27.8	29.3	28.1	29.6	29.8
	4H	30.0	31.5	30.3	31.8	32.0	28.5	30.0	28.8	30.2	30.5
	6H	31.4	32.8	31.7	33.1	33.3	28.9	30.3	29.3	30.6	30.9
	8H	32.1	33.5	32.5	33.8	34.1	29.0	30.4	29.4	30.7	31.0
	12H	33.0	34.3	33.4	34.6	35.0	29.0	30.3	29.4	30.6	30.9
4H	2H	27.3	28.8	27.6	29.1	29.3	26.8	28.3	27.1	28.6	28.8
	3H	29.7	31.0	30.0	31.3	31.6	28.8	30.1	29.2	30.4	30.8
	4H	31.0	32.3	31.4	32.6	32.9	29.7	30.9	30.1	31.2	31.6
	6H	32.6	33.7	33.0	34.0	34.4	30.3	31.4	30.7	31.7	32.1
	8H	33.4	34.5	33.9	34.8	35.2	30.4	31.5	30.9	31.8	32.2
	12H	34.5	35.4	34.9	35.8	36.2	30.5	31.4	30.9	31.8	32.2
8H	4H	31.4	32.4	31.8	32.8	33.2	30.2	31.3	30.7	31.6	32.0
	6H	33.2	34.0	33.6	34.5	34.9	31.1	32.0	31.5	32.4	32.8
	8H	34.2	35.0	34.7	35.4	35.9	31.4	32.2	31.9	32.6	33.1
	12H	35.5	36.1	35.9	36.6	37.1	31.5	32.2	32.0	32.7	33.2
12H	4H	31.4	32.4	31.9	32.8	33.2	30.4	31.3	30.8	31.7	32.1
	6H	33.3	34.1	33.7	34.5	34.9	31.4	32.1	31.8	32.6	33.0
	8H	34.4	35.1	34.9	35.5	36.0	31.8	32.4	32.2	32.9	33.4
Variations with the observer position at spacings:											
S = 1.0H		+ 0.1 / - 0.1					+ 0.1 / - 0.1				
1.5H		+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H		+ 0.2 / - 0.4					+ 0.2 / - 0.5				

CIE Pub.117 Corrected 1091 lm Total Lamp Luminous Flux.(8log(F/F0) = 0.3)

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) k(RI) x RCR = 5									
k = 0.60	52	40	32	52	40	32	50	39	32	25
0.80	62	49	41	61	49	41	59	48	40	33
1.00	70	58	49	69	57	49	66	59	49	41
1.25	77	65	57	76	65	57	73	63	56	48
1.50	83	71	63	81	70	62	78	68	61	53
2.00	90	80	72	88	79	71	84	76	70	61
2.50	94	85	78	92	84	77	88	81	75	66
3.00	98	90	83	96	88	82	92	85	80	71
4.00	103	96	90	100	94	89	96	90	86	76
5.00	106	100	95	103	98	93	98	94	90	80
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended					SHRNOM = 1.25	

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

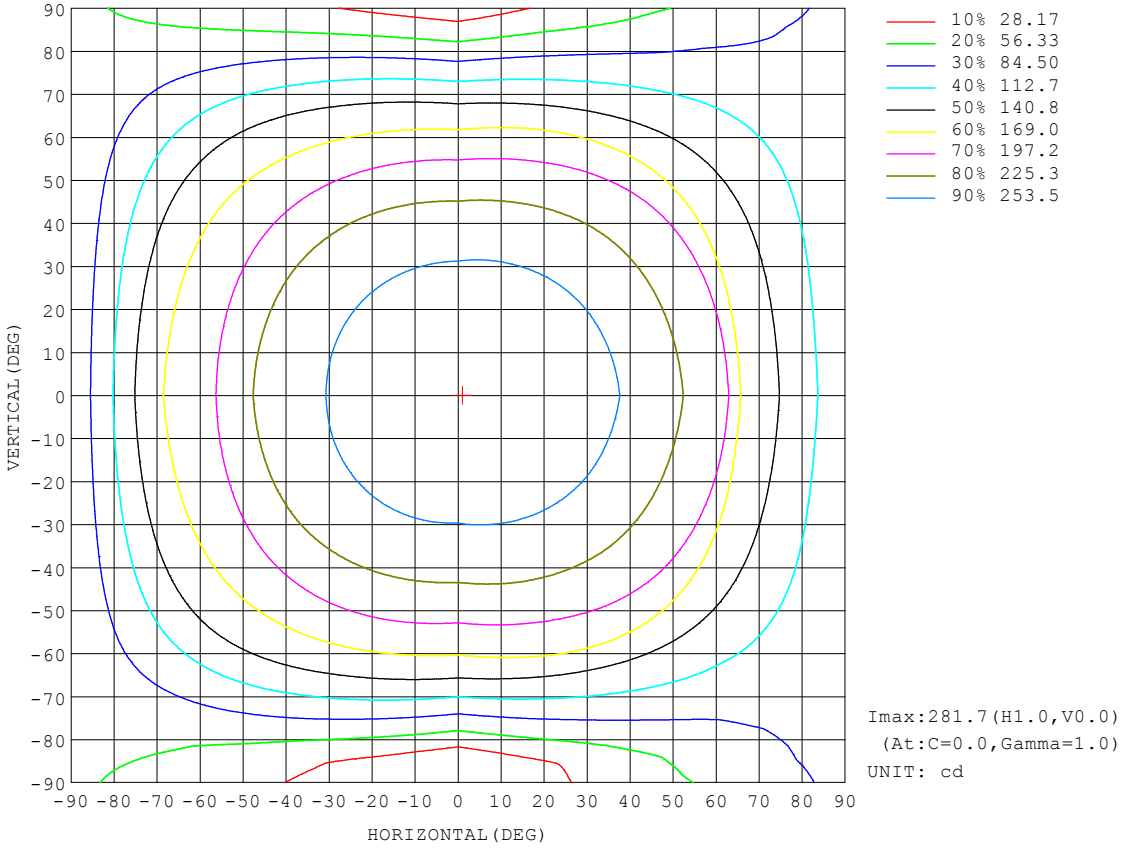


C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

AAI Figure

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

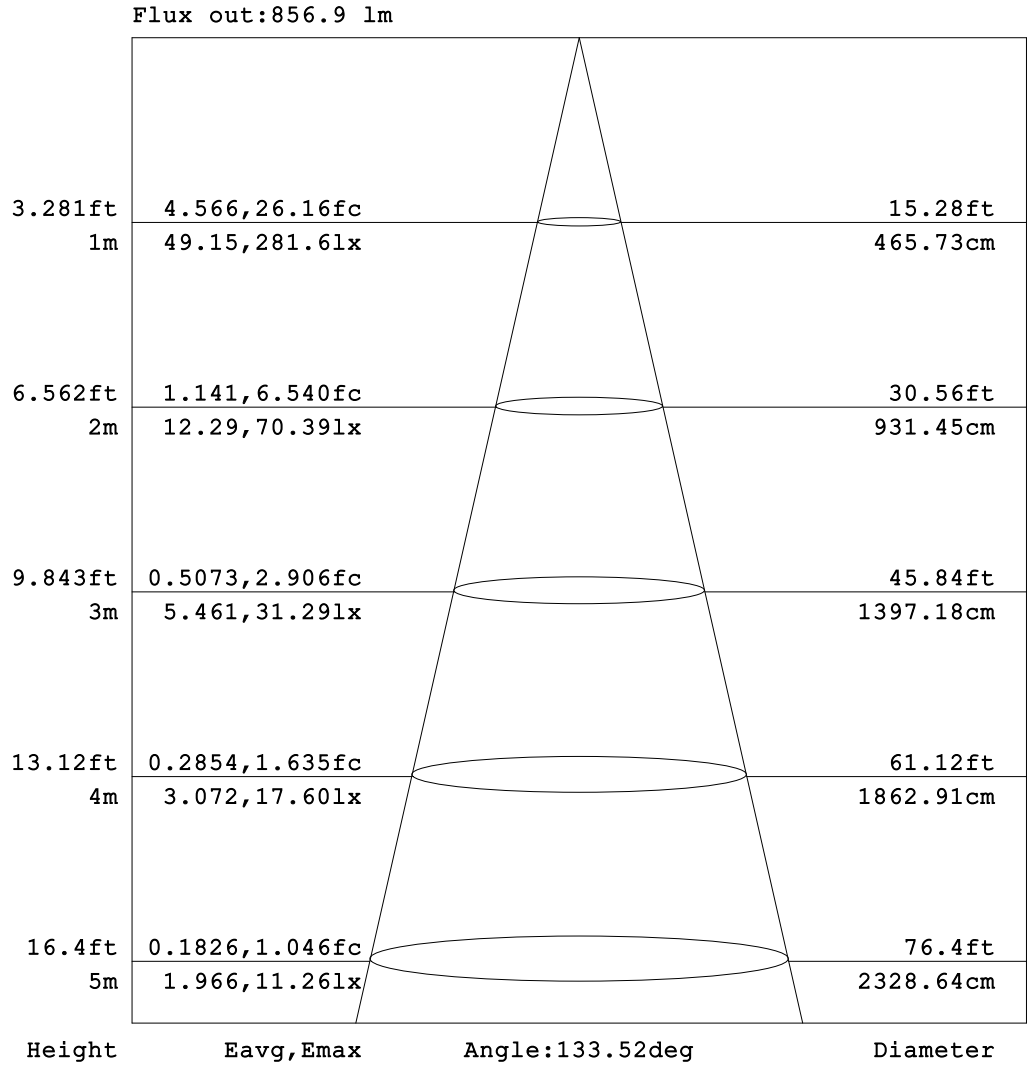


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

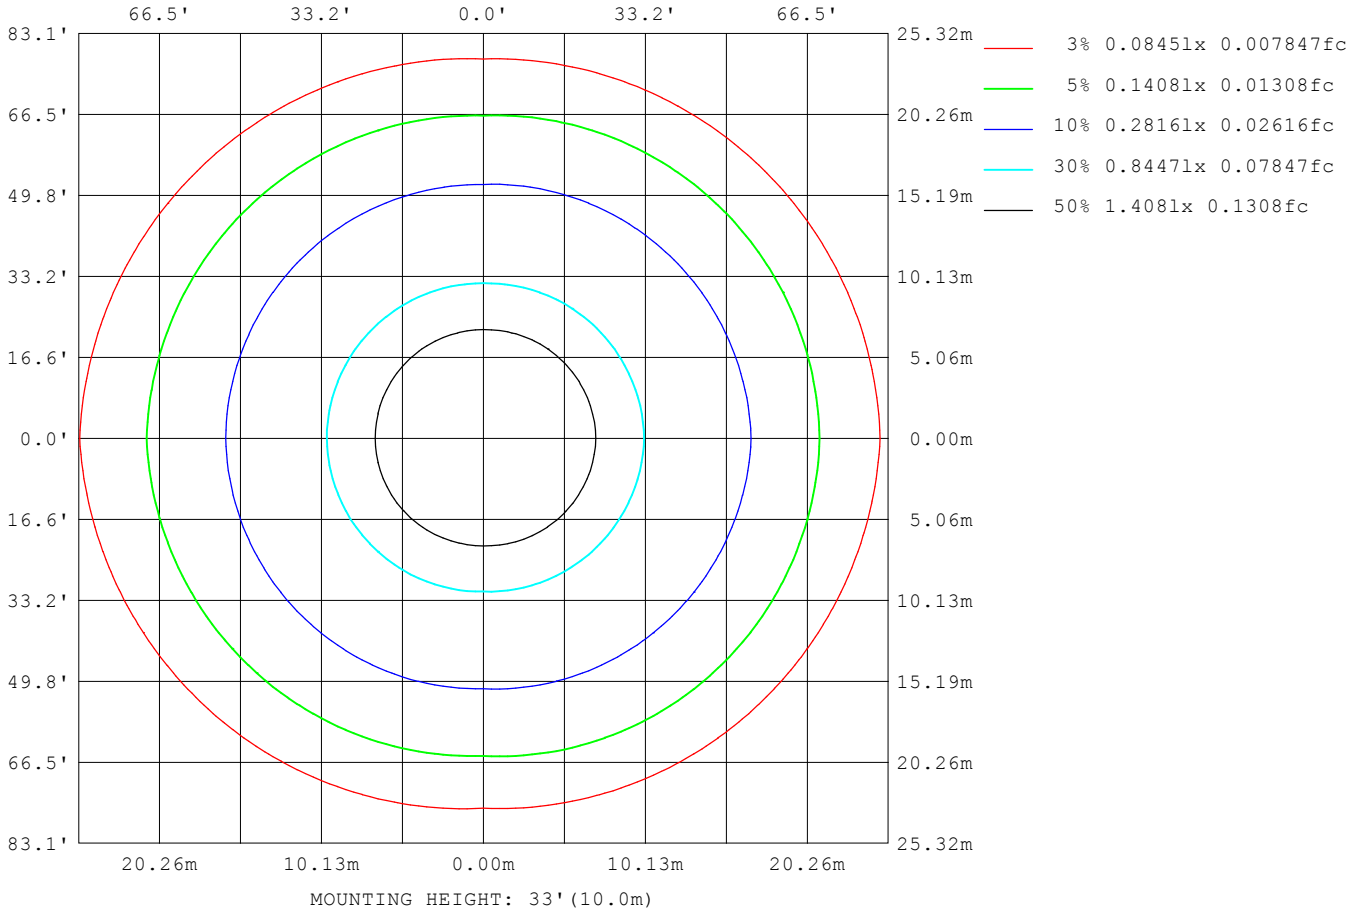

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

Planar Illuminance Curve

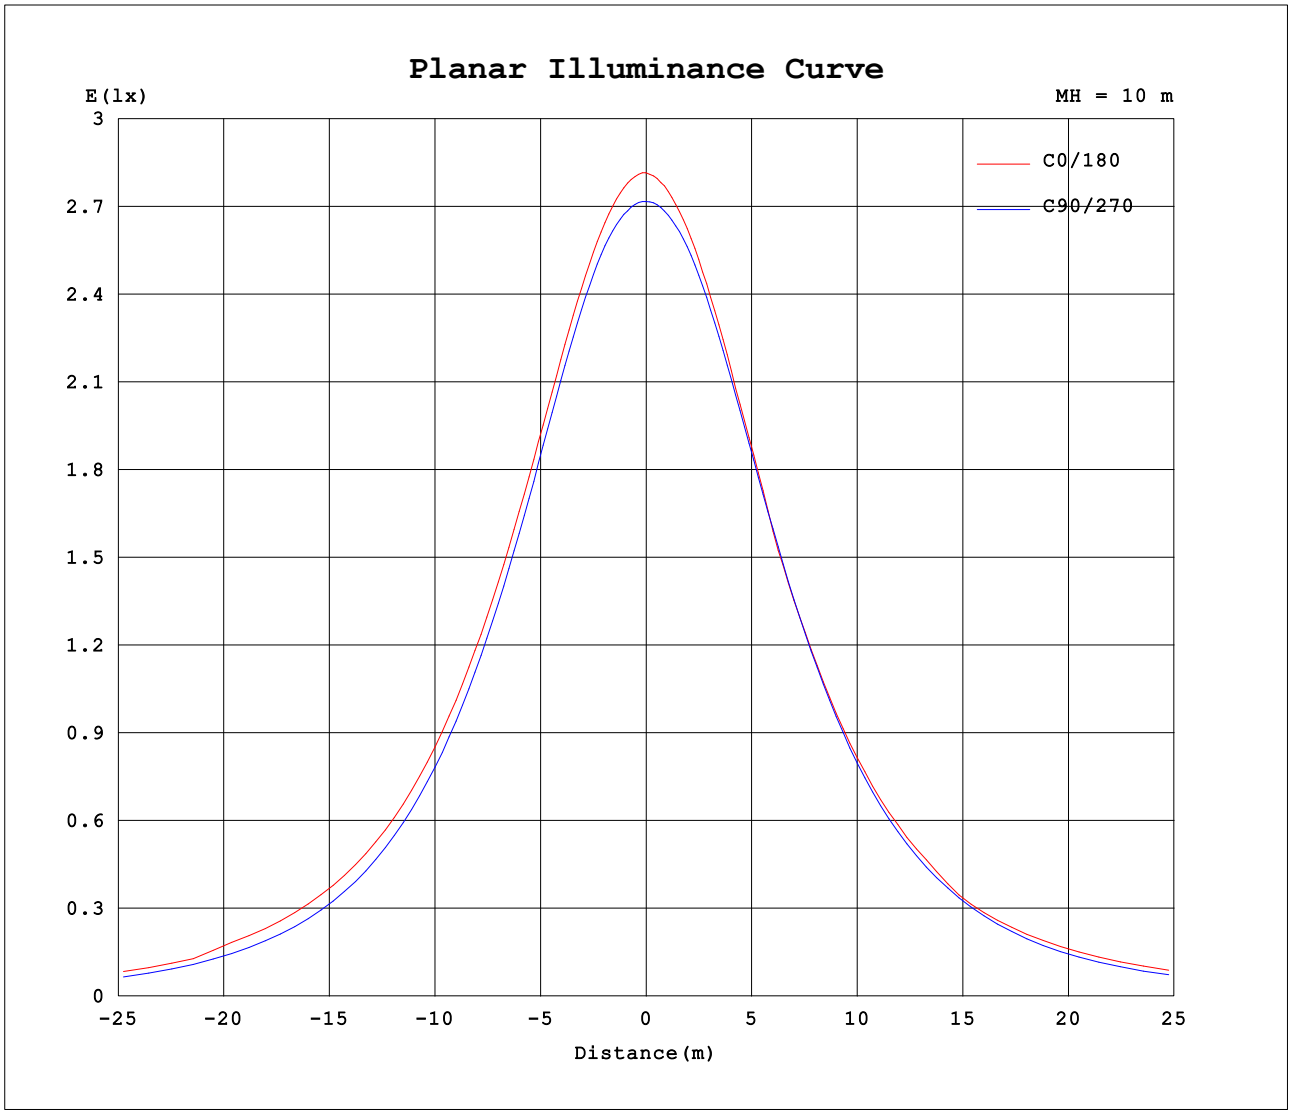

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:24.00V I:0.7800A P:18.72W PF:0 Lamp Flux:1090.54x1 lm		
NAME: HCP-3925195	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:1
MFR.: HAVIT COMMERCIAL	SUR.:0.008	PROTECTION ANGLE:

Table--1 UNIT: cd

γ (DEG) \ C(DEG)	0	90	180	270
0	282	272	282	272
5	281	272	280	272
10	280	271	278	271
15	278	270	275	270
20	275	266	271	266
25	270	261	264	261
30	264	253	256	255
35	258	244	246	247
40	250	234	239	238
45	241	221	231	226
50	230	207	221	212
55	219	190	204	196
60	206	170	188	177
65	171	145	178	154
70	156	113	165	129
75	140	77.4	142	100
80	124	41.1	114	69.7
85	109	6.39	87.2	39.8
90	91.7	1.67	60.8	13.5

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:QUAN
Test Date:2022-12-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.270
Humidity:65.0%
Test Distance:8.140m [K=1.0000]
Remarks: